

ELIGIBILITY EVALUATION REPORT

School District:	Bakersfield City School District	Original Report Date:	August 15, 2018
School Campus:	Horace Mann Elementary School	Last Revision Date:	
School Address:	2710 Niles Street, Bakersfield, CA 93306		
Building Name/ID:	Multi-purpose & Classrooms		
Project Tracking No.:			

The purpose of this evaluation report is to establish eligibility for retrofit funding under Proposition 1D (AB 127, 2006). It is not the intent of this evaluation to provide a complete Life Safety evaluation. The evaluation is complete when eligibility has been determined.

Report Outline

1. Eligibility check summary
2. Evaluation process Appendix A.1. Structural calculations
3. Site and building description Appendix A.2. Evaluation statement notes
4. Deficiency list Appendix A.3 Photographs and details
5. ASCE 31 Evaluation statements



SMITH STRUCTURAL GROUP, LLP

SE Firm Name: Smith Structural Group, LLP
 SE Address: 811 El Capitan Way, Suite 240
 San Luis Obispo, CA 93401

Phone: 805-439-2110
 Email: michael@smithstructural.com



Michael E. Parolini
 Name of SE whose stamp is above

1. Eligibility Check Summary

- | | <u>YES</u> | <u>NO</u> |
|---|-------------------------------------|--------------------------|
| 1.1 Building Occupancy: The building's current or planned use involves regular occupancy by students and staff, as detailed in Section 3.2. | <input checked="" type="checkbox"/> | <input type="checkbox"/> |
| 1.2 Structural System: The building's seismic force-resisting system includes at least one of the types listed in Section 3.5. | <input checked="" type="checkbox"/> | <input type="checkbox"/> |
| 1.3 Collapse Potential: The building has deficiencies associated with a high potential for local or global collapse in the evaluation earthquake. See Sections 4 and 5 for a list of identified deficiencies. Among the identified deficiencies are the critical items checked in Section 1.3.3: | <input checked="" type="checkbox"/> | <input type="checkbox"/> |

**1.3.1 Collapse Potential Due to Ground Shaking: $S_s = 1.18g$ ASCE 7-05
 Occupancy III, Site Class D**

SE Firm Name:	Smith Structural Group, LLP
SE Firm Address:	811 El Capitan Way, Suite 240, San Luis Obispo, CA, 93401
SE Firm Phone #:	805-439-2110

ELIGIBILITY EVALUATION REPORT

School District:	Bakersfield City School District	Original Report Date:	August 15, 2018
School Campus:	Horace Mann Elementary School		
School Address:	2710 Niles Street, Bakersfield, CA 93306	Last Revision Date:	
Building Name/ID:	Multi-purpose & Classrooms		
Project Tracking No.:		Page 2 of 36	

1.3.2 Collapse Potential Due to One of the Following Geologic Hazards (CGS Approved Geologic Hazard Report Required):

- LIQUEFACTION
 SLOPE STABILITY FAILURE
 SURFACE FAULT RUPTURE

UNKNOWN AT THIS TIME

1.3.3 Identified Deficiencies:

- | | | |
|--|--|--|
| <input checked="" type="checkbox"/> LOAD PATH | <input type="checkbox"/> SHEAR STRESS CHECK (COLUMN) | <input type="checkbox"/> UNREINFORCED MASONRY BEARING WALLS |
| <input type="checkbox"/> WEAK STORY | <input type="checkbox"/> AXIAL STRESS CHECK | |
| <input type="checkbox"/> SOFT STORY | <input type="checkbox"/> FLAT SLAB FRAMES | <input type="checkbox"/> SHEAR STRESS CHECK (SHEAR WALL OR INFILL) |
| <input type="checkbox"/> VERTICAL DISCONTINUITIES | <input type="checkbox"/> CAPTIVE COLUMNS | <input type="checkbox"/> REDUNDANCY (SHEAR WALL) |
| <input type="checkbox"/> MASS | <input type="checkbox"/> BEAM BARS | <input checked="" type="checkbox"/> OPENINGS AT SHEAR WALLS |
| <input type="checkbox"/> TORSION | <input type="checkbox"/> DEFLECTION COMPATIBILITY | <input type="checkbox"/> TOPPING SLAB |
| <input checked="" type="checkbox"/> ADJACENT BUILDINGS | <input type="checkbox"/> FLAT SLABS | <input checked="" type="checkbox"/> WALL ANCHORAGE |
| <input type="checkbox"/> MEZZANINES | <input type="checkbox"/> REDUNDANCY | <input type="checkbox"/> OTHER * |

2. Evaluation Process

2.1 Purpose and Scope

As described in DSA Procedure 08-03, the primary purpose of this evaluation is to confirm the subject building's eligibility for Proposition 1D (AB 127, 2006) retrofit funding.

As noted in DSA Procedure 08-03, the intent of this evaluation is to identify conditions that represent "a high potential for catastrophic collapse." As described further in Sections 2.2 through 2.4, the evaluation includes:

- Completion of a standardized checklist developed specially for this project (Section 2.2). As described in Section 2.2, once a critical deficiency is confirmed, the balance of the checklist need not be completed.
- A site visit (Section 2.3)
- Document review (Section 2.4)

It is not the intent of this evaluation to provide a complete Life Safety evaluation; earthquake safety hazards other than those listed in this report might exist. Further, it is not the intent of this evaluation to identify deficiencies with respect to post-earthquake use or recovery feasibility. In particular, except where specifically noted, the scope of this evaluation does not include:

- Material testing or destructive investigation
- Comprehensive condition assessment or verification of construction documents
- Assessment of code compliance, either at present or at the time of construction

SE Firm Name:	Smith Structural Group, LLP
SE Firm Address:	811 El Capitan Way, Suite 240, San Luis Obispo, CA, 93401
SE Firm Phone #:	805-439-2110

PR 08-03
SMP Template
(iss 09-15-11)
(errata 10-11-11)

ELIGIBILITY EVALUATION REPORT

School District:	Bakersfield City School District	Original Report Date:	August 15, 2018
School Campus:	Horace Mann Elementary School		Last Revision Date:
School Address:	2710 Niles Street, Bakersfield, CA 93306		
Building Name/ID:	Multi-purpose & Classrooms		
Project Tracking No.:			

- Assessment for load combinations not including earthquake effects
- Consideration of Life Safety hazards related to egress
- Consideration of Life Safety hazards related to hazardous materials
- Consideration of the effects of damage to nonstructural components or contents.

Building located on sites with geologic hazards (liquefaction, slope failure, faulting) may be eligible for the Proposition 1D funding if it can be demonstrated that the geologic hazard may cause the building to have a high potential for catastrophic collapse. In this case, a geologic hazard report shall be prepared and submitted to CGS for approval and a copy included with evaluation report. The geologic hazard report shall identify the resulting displacements that will be imposed on the structure so a structural analysis can be performed. If eligibility is being sought for a deficiency that is not related to geologic hazards, then a geologic hazard report does not need to be prepared for the purpose of this evaluation report.

With respect to DSA Procedure 08-03, this report fulfills the intent of its Section 1. The remaining sections of Procedure 08-03 are outside the scope of this evaluation and report:

2.2 Evaluation criteria: Modifications to ASCE 31

As noted in DSA Procedure 08-03, the evaluation applies ASCE 31¹, an engineering standard that allows the user to choose a performance level of either Life Safety or Immediate Occupancy. Procedure 08-03 suggests that Life Safety is the performance level of interest, but the Procedure also focuses on collapse, a lesser performance level not explicitly addressed by ASCE 31. For this evaluation, DSA has clarified that only collapse-prone conditions need to be identified. Further, because the focus of this evaluation is on checking eligibility for retrofit funding, as opposed to producing a comprehensive list of potential deficiencies, the full evaluation need not be completed once a critical deficiency is identified.

ASCE 31 involves three “tiers” of evaluation. Tier 1 uses a set of generic, mostly qualitative “evaluation statements” (also called checklists) to identify potential deficiencies. Tier 2 applies more quantitative checks to confirm or correct the Tier 1 findings. Tier 3 involves a more thorough structural analysis. For this evaluation, DSA has clarified that only Tier 1 is required for most issues, with Tier 2 evaluation for specific issues.

The criteria used for this evaluation therefore are based on the ASCE 31 Tier 1 checklists, with the following modifications:

- Basic Structural, Supplemental Structural, and Foundations checklists are considered.
- Nonstructural checklists are excluded. While some issues addressed by these checklists are relevant to nonstructural collapse potential, their completion is beyond the scope of this evaluation. While not considered for purposes of establishing funding eligibility, relevant deficiencies will be investigated and addressed during a retrofit design phase.
- Evaluation statements required by ASCE 31 for Immediate Occupancy only are excluded.
- Evaluation statements not associated with one of the eligible structure types are excluded.
- Certain evaluation statements related to “critical deficiencies” indicative of a high potential for structural collapse are identified. If a critical deficiency is confirmed, the balance of the evaluation need not be completed. The critical deficiencies are those listed in Section 1. They were selected by DSA for this

¹ *Seismic Evaluation of Existing Buildings* (ASCE/SEI 31-03), American Society of Civil Engineers, 2003.

SE Firm Name:	Smith Structural Group, LLP
SE Firm Address:	811 El Capitan Way, Suite 240, San Luis Obispo, CA, 93401
SE Firm Phone #:	805-439-2110

ELIGIBILITY EVALUATION REPORT

School District:	Bakersfield City School District	Original Report Date:	August 15, 2018
School Campus:	Horace Mann Elementary School		
School Address:	2710 Niles Street, Bakersfield, CA 93306	Last Revision Date:	
Building Name/ID:	Multi-purpose & Classrooms		
Project Tracking No.:		Page 4 of 36	

project based in part on precedents set by the California Office of Statewide Health Planning and Development.²

- For Quick Checks and Tier 2 evaluations, the ASCE 31 criteria for Life Safety performance are used, except that *m* values, where needed, are increased by an additional factor of 1.33.
- The Tier 1 evaluation statements are modified to reflect emphasis on collapse-level performance:
 - Since the presence of an unreinforced masonry bearing wall system is deemed a critical deficiency, an evaluation statement to that effect is added, and detailed ASCE 31 evaluation statements specific to that system are omitted.
 - Condition of Materials: Evaluation statements are edited to focus less on presence of damage and more on significance of damage. Note that Masonry Lay-up and Foundation Performance evaluation statements are relocated to the Condition of Materials subsection of Section 5.
 - Except for cracks in certain concrete members, Condition of Materials evaluation statements related to existing cracks are omitted.
 - Beam Bars: The requirement for 25 percent of the joint bars to be continuous for the length of the member is removed.
 - Redundancy (Moment frame and Braced frame): The requirement for two bays per frame line is removed.
 - Stiffness of wall anchors: The limitation of 1/8-inch gap prior to anchor engagement is removed.
 - Overturning: This statement is removed.
 - In general, statements are modified for clarity and consistency with this DSA program.
- Tier 2 evaluation is required for any critical item (see Section 1) found to be non-compliant by Tier 1. The potential requirement for full-building Tier 2 evaluation found in ASCE 31 Table 3-3 is waived.

2.3 Document review

The following documents were provided for use in completing the evaluation, in general compliance with ASCE 31, Section 2.2. The Set ID is used to identify the documents cited in Section 5 of this report.

SET ID	DATE	DESCRIPTION
1	1937	A-1099, Additions to Horace Mann School, Charles H Biggar, Original Drawings, 9 sheets
2	1953	A-11363, Additions and Alterations to Horace Mann Elem School, Ernest L. McCoy, 22 sheets
3	1978	A-41306, Additions and Alterations Horace Mann Elem School, Eddy, Paynter, Renfro & Associates, 48 sheets (Referred to as Unit R)
4	1989	A-51532, Horace Mann Modernization, BFGC Architects-Planners, 42 sheets (Referred to as Building 600)

² 2007 California Building Standards Administrative Code (California Code of Regulations, Title 24 Part 1), Chapter 6, "Seismic Evaluation Procedures for Hospital Buildings," Section 1.4.5.1.2, October 23, 2008 Emergency Supplement.

SE Firm Name:	Smith Structural Group, LLP	PR 08-03 SMP Template (iss 09-15-11) (errata 10-11-11)
SE Firm Address:	811 El Capitan Way, Suite 240, San Luis Obispo, CA, 93401	
SE Firm Phone #:	805-439-2110	

ELIGIBILITY EVALUATION REPORT

School District:	Bakersfield City School District	Original Report Date:	August 15, 2018
School Campus:	Horace Mann Elementary School		
School Address:	2710 Niles Street, Bakersfield, CA 93306	Last Revision Date:	
Building Name/ID:	Multi-purpose & Classrooms		
Project Tracking No.:		Page 5 of 36	

2.4 Site visit

In general compliance with ASCE 31, Sections 2.2 and 2.3, a site visit shall be made to verify the building configuration and conditions and to assist in completing the evaluation.

Date of site visit: July 5, 2018
 Visiting engineer(s) and staff: Jessica Napier, Deryk Izuo
 School district contact person: Randy Rowles
 School campus representative
 (if different than above): same as above

The scope of the site visit was based on our judgment, accessibility of certain areas, and convenience of the school on-site liaison. The purpose of the following list is merely to record the work that was done. The site visit included (check all applicable boxes):

- INTERVIEW W/ ON-SITE LIAISON
- GROUNDS, FOR OBSERVATION OF SOIL, SLOPES, DRAINAGE, GENERAL CONDITION
- EXTERIOR OBSERVATION TO VERIFY BASIC MASSING, CONFIGURATION, GENERAL CONDITION
- INTERIOR OBSERVATION TO VERIFY USE, WALL LINE CONFIGURATION, GENERAL CONDITION
- ROOF
- BASEMENT
- CEILING PLENUM
- UNFINISHED SPACES (MECHANICAL ROOMS, CLOSETS, CRAWL SPACES, ETC.)
- DETAILS OF STRUCTURE-ARCHITECTURE INTERACTION
- ROOF-TO-WALL CONNECTIONS
- GRAVITY SYSTEM FRAMING
- SEISMIC FORCE RESISTING SYSTEM ELEMENTS OR COMPONENTS
- ADJACENT BUILDINGS SUBJECT TO POUNDING
- OTHER:

The site visit confirmed that the existing structure generally conforms to the available drawings listed in Section 2.3.

SE Firm Name:	Smith Structural Group, LLP
SE Firm Address:	811 El Capitan Way, Suite 240, San Luis Obispo, CA, 93401
SE Firm Phone #:	805-439-2110

ELIGIBILITY EVALUATION REPORT

School District:	Bakersfield City School District	Original Report Date:	August 15, 2018
School Campus:	Horace Mann Elementary School	Last Revision Date:	
School Address:	2710 Niles Street, Bakersfield, CA 93306		
Building Name/ID:	Multi-purpose & Classrooms		
Project Tracking No.:		Page 6 of 36	

3. Site and Building Description

3.1 Building description

General

Year originally built: 1937

DSA Application number 1099

Original Construction

Work done pursuant to the Garrison Act (Ed Code 17367)


Number of stories above grade: 1

Number of stories below grade: 0

Total floor area (sq ft, approx): 8,600 sq. ft.

Other essentially identical buildings on this campus? Yes No

Overhead view of Horace Mann Elementary, taken: July 26, 2018 using Google Earth

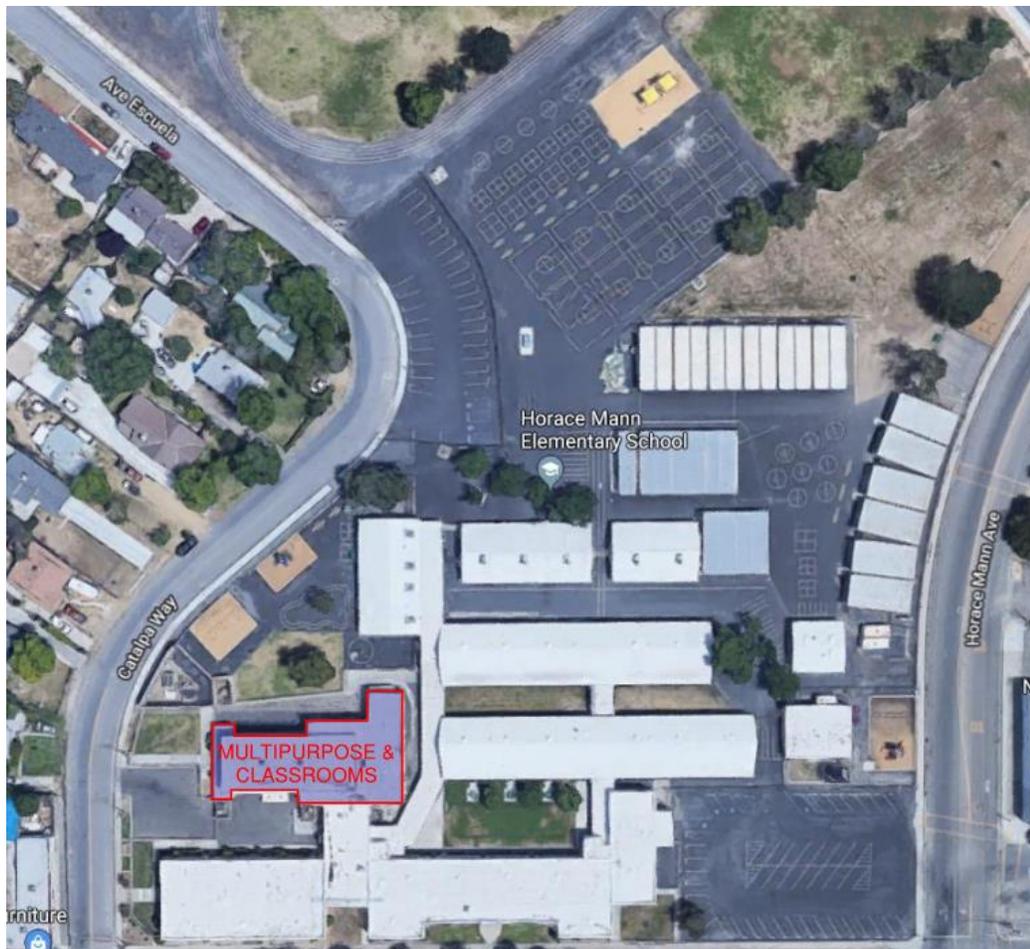

SE Firm Name:	Smith Structural Group, LLP
SE Firm Address:	811 El Capitan Way, Suite 240, San Luis Obispo, CA, 93401
SE Firm Phone #:	805-439-2110

PR 08-03
SMP Template
(iss 09-15-11)
(errata 10-11-11)

ELIGIBILITY EVALUATION REPORT

School District:	Bakersfield City School District	Original Report Date:	August 15, 2018
School Campus:	Horace Mann Elementary School	Last Revision Date:	
School Address:	2710 Niles Street, Bakersfield, CA 93306		
Building Name/ID:	Multi-purpose & Classrooms		
Project Tracking No.:			Page 7 of 36

Photographs

Exterior elevation photograph, looking east, taken: July 5, 2018



Exterior elevation photograph, looking south, taken: August 2, 2018 with Google Earth:




SE Firm Name:	Smith Structural Group, LLP
SE Firm Address:	811 El Capitan Way, Suite 240, San Luis Obispo, CA, 93401
SE Firm Phone #:	805-439-2110

PR 08-03
SMP Template
(iss 09-15-11)
(errata 10-11-11)

ELIGIBILITY EVALUATION REPORT

School District:	Bakersfield City School District	Original Report Date:	August 15, 2018
School Campus:	Horace Mann Elementary School	Last Revision Date:	
School Address:	2710 Niles Street, Bakersfield, CA 93306		
Building Name/ID:	Multi-purpose & Classrooms		
Project Tracking No.:			Page 8 of 36

Ground floor plan

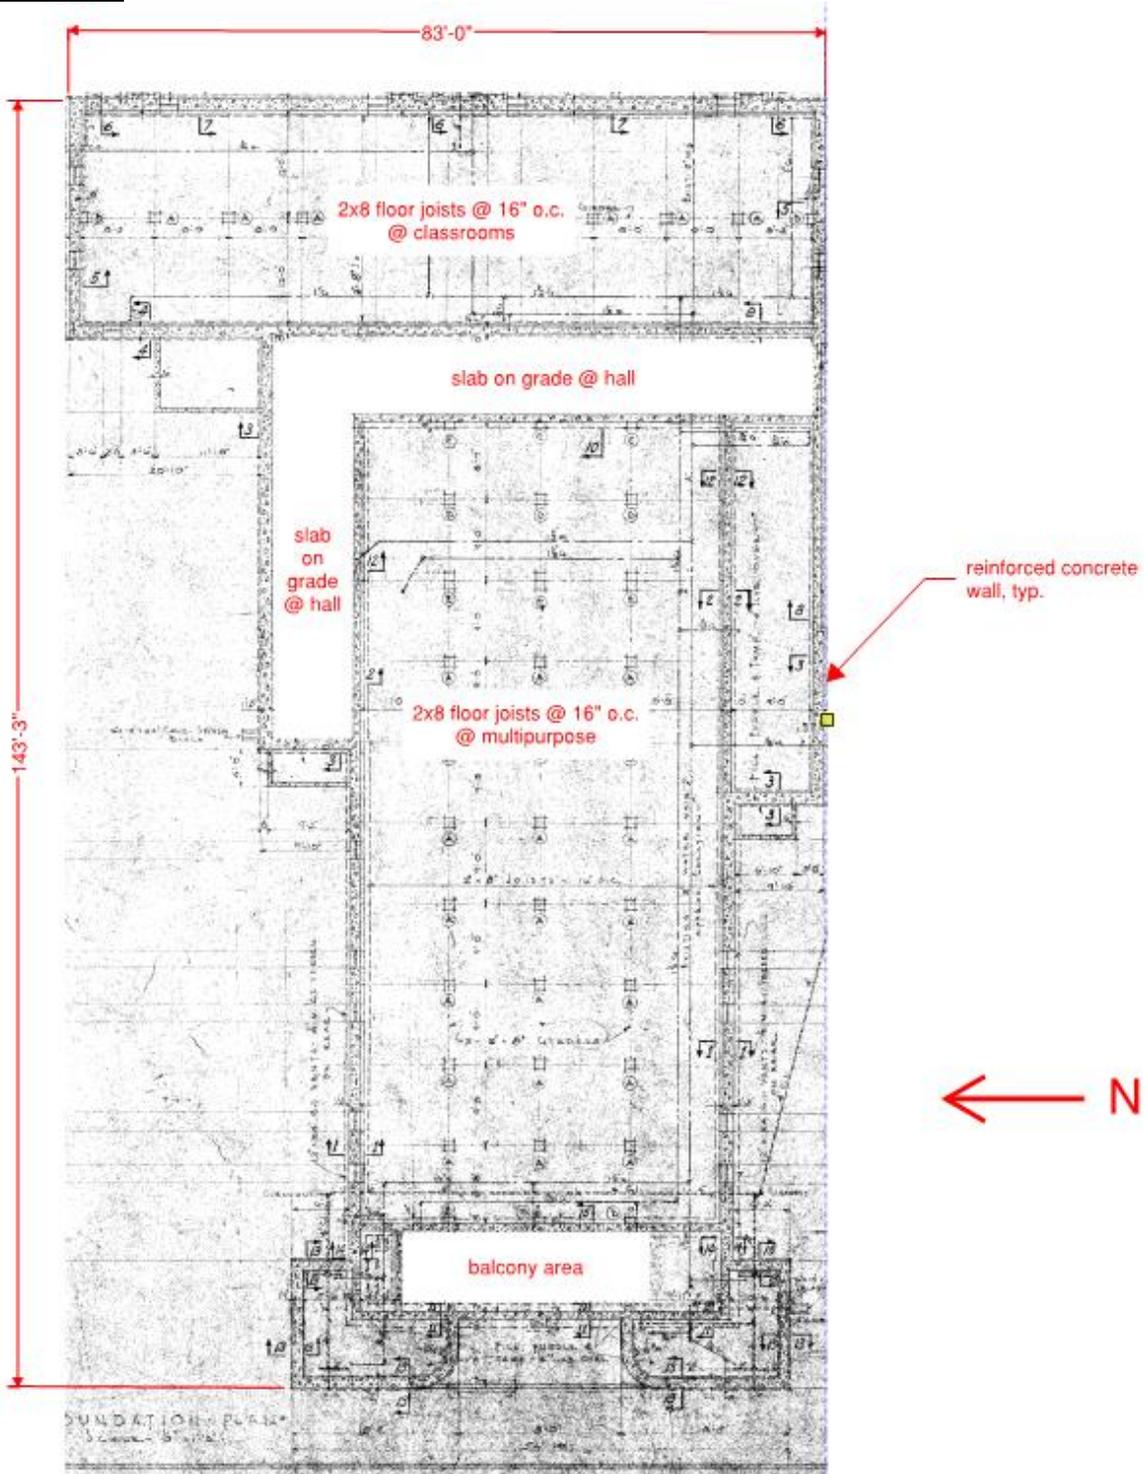

SE Firm Name:	Smith Structural Group, LLP
SE Firm Address:	811 El Capitan Way, Suite 240, San Luis Obispo, CA, 93401
SE Firm Phone #:	805-439-2110

PR 08-03
 SMP Template
 (iss 09-15-11)
 (errata 10-11-11)

ELIGIBILITY EVALUATION REPORT

School District:	Bakersfield City School District	Original Report Date:	August 15, 2018
School Campus:	Horace Mann Elementary School		
School Address:	2710 Niles Street, Bakersfield, CA 93306	Last Revision Date:	
Building Name/ID:	Multi-purpose & Classrooms		
Project Tracking No.:		Page 9 of 36	

3.2 Building Occupancy

Original, current, and planned uses of the building include those indicated here:

	ORIGINAL USE	CURRENT USE	PLANNED FUTURE USE
OFFICE / ADMINISTRATION	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
CLASSROOMS / INSTRUCTION AREAS	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>
KITCHEN	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
ASSEMBLY: DINING	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>
ASSEMBLY: AUDITORIUM	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>
ASSEMBLY: GYMNASIUM	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
LOCKER ROOMS	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
PATIO COVER / BUS SHELTER / WALKWAY COVER	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
BLEACHERS / STADIUM STRUCTURE	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
OTHER OCCUPIED: <i>complete as appropriate</i>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
MECHANICAL / UTILITY ROOMS OR ENCLOSURES	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
BULK STORAGE	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
VACANT / UNUSED	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
OTHER UNOCCUPIED:	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>

3.3 Seismicity

Latitude: 35.3769081

Longitude: -118.9574422

Site Class per ASCE 31, Section 3.5.2.3: D

Basis for Site Class determination: Default

Period [sec]	Mapped MCE values from ASCE 7-05 [g]	Site Coefficients from ASCE 31 Tables 3-5, 3-6	Design values per ASCE 31 section 3.5.2.3.1 [g]	S_a per ASCE 31 section 3.5.2.3.1, [g]
0.2	$S_S = 1.18$	$F_a = 1.028$	$S_{DS} = (2/3) S_S F_a = 0.809$	$S_{a,0.2} = S_{DS} = 0.809$
1.0	$S_I = 0.419$	$F_v = 1.581$	$S_{DI} = (2/3) S_I F_v = 0.441$	$S_{a,1.0} = \min(S_{DS}, S_{DI}/T) = 0.441$

SE Firm Name:	Smith Structural Group, LLP
SE Firm Address:	811 El Capitan Way, Suite 240, San Luis Obispo, CA, 93401
SE Firm Phone #:	805-439-2110

PR 08-03
SMP Template
(iss 09-15-11)
(errata 10-11-11)

ELIGIBILITY EVALUATION REPORT

School District:	Bakersfield City School District	Original Report Date:	August 15, 2018
School Campus:	Horace Mann Elementary School		
School Address:	2710 Niles Street, Bakersfield, CA 93306	Last Revision Date:	
Building Name/ID:	Multi-purpose & Classrooms		
Project Tracking No.:		Page 10 of 36	

3.4 Gravity System

Roof diaphragm and framing over classrooms, multipurpose, north and south halls:

- 1x6 diagonal sheathing
- 2x rafters @ 24" o.c.
- Ledger connected to concrete with 5/8" diameter x 10" bolts @ 48" o.c.
- At multipurpose, rafters are supported by WF beams that are connected to north and south walls

Roof diaphragm over balcony and hall between multipurpose and classrooms

- Reinforced concrete slab

Typical floor diaphragm and framing: N/A

Ground floor framing:

- 1 layer of 1x diagonal sheathing with wood finish floor over top (1x straight).
- 2x floor joists over beams at interior and hung from wood ledger at exterior concrete stem wall.

Vertical load-bearing elements:

- Bearing walls are typically 10" reinforced concrete at multipurpose and 8" reinforced concrete elsewhere

Basement walls: N/A, no basement.

Foundation:

- Continuous concrete footings under concrete walls
- Shallow pier footings at interior, under wood posts

Snow load for use in load combinations involving earthquake: N/A, snow load not required.

SE Firm Name:	Smith Structural Group, LLP
SE Firm Address:	811 El Capitan Way, Suite 240, San Luis Obispo, CA, 93401
SE Firm Phone #:	805-439-2110

PR 08-03
SMP Template
(iss 09-15-11)
(errata 10-11-11)

ELIGIBILITY EVALUATION REPORT

School District:	Bakersfield City School District	Original Report Date:	August 15, 2018
School Campus:	Horace Mann Elementary School		
School Address:	2710 Niles Street, Bakersfield, CA 93306	Last Revision Date:	
Building Name/ID:	Multi-purpose & Classrooms		
Project Tracking No.:		Page 11 of 36	

3.5 Structural System per ASCE 31 Classifications (Category 2 Buildings Types per AB 300 Report)

	North-South	East-West
C1 Concrete Moment Frames	<input type="checkbox"/>	<input type="checkbox"/>
C1B* Reinforced Concrete Cantilever Columns	<input type="checkbox"/>	<input type="checkbox"/>
C2A Concrete Shear Walls, Flexible Diaphragm	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>
C3A Concrete Frame with Infill Masonry Shear Walls, Flexible Diaphragm	<input type="checkbox"/>	<input type="checkbox"/>
PC1 Precast/Tilt-up Concrete Shear Walls, Flexible Diaphragm	<input type="checkbox"/>	<input type="checkbox"/>
PC1A Precast/Tilt-up Concrete Shear Walls, Rigid Diaphragm	<input type="checkbox"/>	<input type="checkbox"/>
PC2 Precast Concrete Frames with Shear Walls, Rigid Diaphragm	<input type="checkbox"/>	<input type="checkbox"/>
PC2A Precast Concrete Frames without Shear Walls, Rigid Diaphragm	<input type="checkbox"/>	<input type="checkbox"/>
RM1 Reinforced Masonry Bearing Walls, Flexible Diaphragm	<input type="checkbox"/>	<input type="checkbox"/>
S1B* Steel Cantilever Columns	<input type="checkbox"/>	<input type="checkbox"/>
S3 Steel Light Frames	<input type="checkbox"/>	<input type="checkbox"/>
URM Unreinforced Masonry Bearing Walls, Flexible Diaphragm	<input type="checkbox"/>	<input type="checkbox"/>
URMA Unreinforced Masonry Bearing Walls, Rigid Diaphragm	<input type="checkbox"/>	<input type="checkbox"/>
M* Mixed Systems - construction containing at least one of the above lateral-force-resisting systems in at least one direction of seismic loading.	<input type="checkbox"/>	<input type="checkbox"/>
None of the above	<input type="checkbox"/>	<input type="checkbox"/>

* These structural systems are a subset of the classification in ASCE 31 and are defined in the Category 2 building types in the AB 300 Seismic Safety Inventory of California Public Schools report (2002).

SE Firm Name:	Smith Structural Group, LLP
SE Firm Address:	811 El Capitan Way, Suite 240, San Luis Obispo, CA, 93401
SE Firm Phone #:	805-439-2110

PR 08-03
SMP Template
(iss 09-15-11)
(errata 10-11-11)

ELIGIBILITY EVALUATION REPORT

School District:	Bakersfield City School District	Original Report Date:	August 15, 2018
School Campus:	Horace Mann Elementary School		
School Address:	2710 Niles Street, Bakersfield, CA 93306	Last Revision Date:	
Building Name/ID:	Multi-purpose & Classrooms		
Project Tracking No.:		Page 12 of 36	

Brief description of structural systems:

Horizontal system combinations	<p>Roof</p> <ul style="list-style-type: none"> • 1x6 diagonal sheathing • 2x rafters • At multipurpose, rafters bear on WF beams, beams are connected to walls <p>Floor</p> <ul style="list-style-type: none"> • 1x6 diagonal sheathing • 2x floor joists
Vertical system combinations	<ul style="list-style-type: none"> • 10" concrete walls at multipurpose, 8" concrete walls elsewhere • Interior stud walls are partition walls only and connect to wide flange beams at top. Wide flanges in this area have no other load on them beyond self-weight and partition wall OOP loads
SFRS foundation	<ul style="list-style-type: none"> • Continuous concrete footings
Gravity loading	<p>Multipurpose: Approximately half of the gravity loads in this area are carried by the north and south walls of the multipurpose. 2x Rafters run E-W and bear on WF beams running N-S.</p> <p>Classrooms: Approximately half of the gravity loads in this area are carried by the east and west walls of the classrooms. 2x Rafters run E-W and bear on the concrete walls.</p>
System details	<p>The SFRS in both directions consists of a wood-framed diaphragm with diagonal sheathing and reinforced concrete shear walls.</p> <p>Walls are tied to diaphragm for in-plane loads with ledger anchor bolts.</p> <p>Walls are not tied to diaphragm for out-of-plane loads.</p>
Structural materials	<p>1937 construction – Sheet 1 of Set 1 2,000-psi concrete</p> <p>Assumed values – Structural and reinforcing steel 33-ksi</p>
Original design code	1935 Uniform Building Code (assumed)
History of seismic retrofit or significant alteration	None. Drawing sets after original construction are provided with this report for reference as to minor alterations made.
Benchmark year check	Benchmark for C2A structure is 1994

SE Firm Name:	Smith Structural Group, LLP
SE Firm Address:	811 El Capitan Way, Suite 240, San Luis Obispo, CA, 93401
SE Firm Phone #:	805-439-2110

PR 08-03
SMP Template
(iss 09-15-11)
(errata 10-11-11)

ELIGIBILITY EVALUATION REPORT

School District:	Bakersfield City School District	Original Report Date:	August 15, 2018
School Campus:	Horace Mann Elementary School		
School Address:	2710 Niles Street, Bakersfield, CA 93306	Last Revision Date:	
Building Name/ID:	Multi-purpose & Classrooms		
Project Tracking No.:		Page 13 of 36	

4. Deficiency list

The following table summarizes the potential deficiencies identified in Section 5 of this report.

Non-compliant condition	Discussion	Additional evaluation recommended
DETERIORATION OF WOOD	<ul style="list-style-type: none"> Seen in ceiling space kitchen and over multipurpose Local collapse mechanism 	None
LOAD PATH	<p>See the following non-compliant conditions in this section:</p> <ul style="list-style-type: none"> Cross ties Wall anchorage 	None
ADJACENT BUILDINGS	<ul style="list-style-type: none"> Separation of 6" between adjacent structures is noted on the plans and verified in the field Local collapse mechanism It is most likely that pounding will not occur, as the SFRS is concrete shear walls in in this structure and URM/gunite in adjacent structure 	None
WALL OPENINGS	<ul style="list-style-type: none"> Wall piers less than 2:1 ratio in most locations Local collapse mechanism, but could extend to along length of wall with adjacent tall piers 	None
DIAPHRAGM CONTINUITY	<ul style="list-style-type: none"> Step in diaphragm occurs between multipurpose and adjacent areas of the structure Local collapse mechanism along wall lines where this occurs 	None
CROSS TIES	<ul style="list-style-type: none"> Cross ties do not exist where rafters are parallel to shear walls Global collapse mechanism 	None
UNBLOCKED DIAPHRAGMS	<ul style="list-style-type: none"> Diaphragms are unblocked and 90'-0" max span Global collapse mechanism 	None
WALL ANCHORAGE <i>Critical Item</i>	<ul style="list-style-type: none"> No anchors to resist OOP forces Global collapse mechanism 	None

SE Firm Name:	Smith Structural Group, LLP
SE Firm Address:	811 El Capitan Way, Suite 240, San Luis Obispo, CA, 93401
SE Firm Phone #:	805-439-2110

PR 08-03
SMP Template
(iss 09-15-11)
(errata 10-11-11)

ELIGIBILITY EVALUATION REPORT

School District:	Bakersfield City School District	Original Report Date:	August 15, 2018
School Campus:	Horace Mann Elementary School		
School Address:	2710 Niles Street, Bakersfield, CA 93306	Last Revision Date:	
Building Name/ID:	Multi-purpose & Classrooms		
Project Tracking No.:		Page 14 of 36	

WOOD LEDGERS	<ul style="list-style-type: none"> • Cross grain bending under gravity loads is possible • Local collapse mechanism • Ledgers observed have not failed in this manner 	None
TIES BETWEEN FOUNDATION ELEMENTS	<ul style="list-style-type: none"> • There are no ties between exterior wall continuous footings and interior shallow pier footings • Local collapse mechanism 	None

Unknown condition	Discussion	Additional evaluation recommended
ROOF CHORD CONTINUITY	<ul style="list-style-type: none"> • If horizontal wall reinforcement is not located near diaphragm edges, there will be a continuity issue • Local collapse mechanism, limited to areas without reinforcement. However, the likelihood of non-conformance is low, since the walls are regularly reinforced 	None
LIQUEFICATION	<ul style="list-style-type: none"> • If liquefaction is a hazard on this site, the foundation would not be adequate for supporting the structure • Global collapse mechanism 	None
SURFACE FAULT RUPTURE	<ul style="list-style-type: none"> • If surface fault rupture is a hazard on this site, the foundation would not be adequate for the soil • Global collapse mechanism 	None

SE Firm Name:	Smith Structural Group, LLP
SE Firm Address:	811 El Capitan Way, Suite 240, San Luis Obispo, CA, 93401
SE Firm Phone #:	805-439-2110

ELIGIBILITY EVALUATION REPORT

School District:	Bakersfield City School District	Original Report Date:	August 15, 2018
School Campus:	Horace Mann Elementary School	Last Revision Date:	
School Address:	2710 Niles Street, Bakersfield, CA 93306		
Building Name/ID:	Multi-purpose & Classrooms		
Project Tracking No.:			Page 15 of 36

5. ASCE 31 Evaluation Statements

Evaluation statements provided in this section are from ASCE 31. They have been modified for this project with DSA approval as described in Section 2.2 of this report. References within the evaluation statements to other section numbers are generally to sections of ASCE 31.

C = Compliant

NC = Non-compliant

U = Unknown or not investigated

NA = Not applicable to this building

Items marked NC or U are summarized in Section 4 of this report.

CONDITION OF MATERIALS	
C <input checked="" type="checkbox"/> NC U NA	<p>DETERIORATION OF WOOD. There shall be no evidence of or reason to suspect structural capacity loss due to decay, shrinkage, splitting, fire damage, or sagging in wood members or deterioration, damage, or loosening in metal connection hardware.</p> <p><i>Visible water damage to roof at west wall of roof access/storage room in balcony area and also over kitchen.</i></p>
<input checked="" type="checkbox"/> NC U NA	<p>DETERIORATION OF CONCRETE. There shall be no evidence of or reason to suspect structural capacity loss due to cracking of concrete or deterioration of concrete or reinforcing steel in gravity or seismic force-resisting elements.</p>
<input checked="" type="checkbox"/> NC U NA	<p>DETERIORATION OF STEEL. There shall be no evidence of or reason to suspect structural capacity loss due to rusting, corrosion, cracking, or other deterioration in any of the steel elements or connections in the gravity or seismic force-resisting elements.</p> <p><i>Rust observed at west wall of roof access/storage room; appears surficial.</i></p>
C NC U <input checked="" type="checkbox"/> NA	<p>POST-TENSIONING ANCHORS. There shall be no evidence of or reason to suspect structural capacity loss due to corrosion or spalling in the vicinity of post-tensioning or end fittings. Coil anchors shall not have been used.</p> <p><i>(Post-tensioning not used)</i></p>

SE Firm Name:	Smith Structural Group, LLP
SE Firm Address:	811 El Capitan Way, Suite 240, San Luis Obispo, CA, 93401
SE Firm Phone #:	805-439-2110

PR 08-03
SMP Template
(iss 09-15-11)
(errata 10-11-11)

ELIGIBILITY EVALUATION REPORT

School District:	Bakersfield City School District	Original Report Date:	August 15, 2018
School Campus:	Horace Mann Elementary School	Last Revision Date:	
School Address:	2710 Niles Street, Bakersfield, CA 93306		
Building Name/ID:	Multi-purpose & Classrooms		
Project Tracking No.:			Page 16 of 36

C NC U <input type="checkbox"/> NA	<p>PRECAST CONCRETE WALLS. There shall be no evidence of or reason to suspect structural capacity loss due to deterioration of concrete or reinforcing steel or distress, especially at connections.</p> <p><i>(Precast concrete not used)</i></p>
C NC U <input type="checkbox"/> NA	<p>MASONRY UNITS. There shall be no evidence of or reason to suspect structural capacity loss due to deterioration of masonry units.</p> <p><i>Masonry at this structure is veneer only.</i></p>
C NC U <input type="checkbox"/> NA	<p>MASONRY JOINTS. The mortar shall not be easily scraped away from the joints by hand with a metal tool, and there shall be no evidence of or reason to suspect structural capacity loss due to eroded mortar.</p> <p><i>Masonry at this structure is veneer only. Although some joints do scrape easily, the structural concrete wall is intact.</i></p>
C NC U <input type="checkbox"/> NA	<p>MASONRY LAY-UP. Filled collar joints of multi-wythe masonry infill walls shall have negligible voids.</p> <p><i>Masonry at this structure is veneer only.</i></p>
<input checked="" type="checkbox"/> NC U NA	<p>FOUNDATION PERFORMANCE. There shall be no evidence of or reason to suspect existing foundation movement (due to settlement, heave, or other causes) that would affect the integrity or strength of the structure.</p>

BUILDING CONFIGURATION

C <input checked="" type="checkbox"/> NC U NA Critical Item	<p>LOAD PATH. The structure shall contain a minimum of one complete load path for seismic force effects from any horizontal direction that serves to transfer the inertial forces from the mass to the foundation.</p> <p><i>O.O.P. wall ties at roof</i></p>
C NC U <input type="checkbox"/> NA Critical Item	<p>WEAK STORY. The strength of the seismic force-resisting system in any story shall not be less than 80% of the strength in an adjacent story, above or below.</p> <p><i>One story</i></p>

SE Firm Name:	Smith Structural Group, LLP
SE Firm Address:	811 El Capitan Way, Suite 240, San Luis Obispo, CA, 93401
SE Firm Phone #:	805-439-2110

ELIGIBILITY EVALUATION REPORT

School District:	Bakersfield City School District	Original Report Date:	August 15, 2018
School Campus:	Horace Mann Elementary School	Last Revision Date:	
School Address:	2710 Niles Street, Bakersfield, CA 93306		
Building Name/ID:	Multi-purpose & Classrooms		
Project Tracking No.:			Page 17 of 36

<p>C NC U NA</p> <p>Critical Item</p>	<p>SOFT STORY. The stiffness of the seismic force-resisting system in any story shall not be less than 70% of the seismic force-resisting system stiffness in an adjacent story above or below, or less than 80% of the average seismic force-resisting system stiffness of the three stories above or below.</p> <p><i>One story</i></p>
<p>C NC U NA</p> <p>Critical Item</p>	<p>GEOMETRY. There shall be no changes in horizontal dimension of the seismic force-resisting system of more than 30% in a story relative to adjacent stories, excluding one-story penthouses and mezzanines.</p> <p><i>One story</i></p>
<p>C NC U NA</p> <p>Critical Item</p>	<p>VERTICAL DISCONTINUITIES. All vertical elements of the seismic force-resisting system shall be continuous to the foundation.</p> <p><i>One story</i></p>
<p>C NC U NA</p> <p>Critical Item</p>	<p>MASS. There shall be no change in effective mass more than 50% from one story to the next. Light roofs, penthouses and mezzanines need not be considered.</p> <p><i>One story</i></p>
<p>C NC U NA</p> <p>Critical Item</p>	<p>TORSION. The estimated distance between the story center of mass and the story center of rigidity shall be less than 20% of the building width in either plan dimension.</p> <p><i>Building has a flexible diaphragm – check that torsion is not an issue</i></p>

SE Firm Name:	Smith Structural Group, LLP
SE Firm Address:	811 El Capitan Way, Suite 240, San Luis Obispo, CA, 93401
SE Firm Phone #:	805-439-2110

ELIGIBILITY EVALUATION REPORT

School District:	Bakersfield City School District	Original Report Date:	August 15, 2018
School Campus:	Horace Mann Elementary School	Last Revision Date:	
School Address:	2710 Niles Street, Bakersfield, CA 93306		
Building Name/ID:	Multi-purpose & Classrooms		
Project Tracking No.:			Page 18 of 36

<p><input checked="" type="checkbox"/> C NC U NA</p> <p>Critical Item</p>	<p>ADJACENT BUILDINGS. The clear distance between the building being evaluated and any adjacent building shall be greater than 4% of the height of the shorter building. Alternatively, if the 4% separation does not exist, the two buildings shall be configured such that pounding would not damage the columns of the subject building within the clear span of the columns.</p> <p><i>Roof height of original classroom building at north wall of kitchen is 16'-7" average. Roof height of adjacent kitchen area is 13'-0". There is a 6" separation between the two structures.</i></p> <p><i>13.0' x 4% = 0.52', or 6.2" separation required per this check</i></p> <p><i>Deflection of adjacent concrete shear wall structures and the URM/gunite structure would be much lower than other SFRS systems. Therefore, although the buildings may move toward each other in a seismic event, the chance of them pounding with the current 6" separation is very low. Tier 2 check not performed.</i></p>
<p><input type="checkbox"/> C NC U NA</p> <p>Critical Item</p>	<p>MEZZANINES. Interior mezzanine levels shall be braced independently from the main structure, or shall be anchored to the seismic force-resisting elements of the main structure.</p> <p><i>Balcony mezzanine is framed with a concrete floor that is connected to concrete shear walls on all diaphragm edges.</i></p>
<p>MOMENT FRAMES</p>	
<p><input type="checkbox"/> C NC U NA</p> <p>Critical Item</p>	<p>SHEAR STRESS CHECK (Columns). The shear stress in concrete columns of the seismic force-resisting system, calculated using the Quick Check procedure of Section 3.5.3.2, shall be less than the greater of 100 psi or $2\sqrt{f_c}$.</p> <p><i>(Moment frames not used)</i></p>
<p><input type="checkbox"/> C NC U NA</p> <p>Critical Item</p>	<p>AXIAL STRESS CHECK (Concrete columns). The axial stress due to gravity loads in columns subjected to seismic overturning forces shall be less than $0.10f_c$. Alternatively, the axial stresses due to overturning forces alone, calculated using the Quick Check procedure of Section 3.5.3.6, shall be less than $0.30f_c$.</p> <p><i>(Moment frames not used)</i></p>

SE Firm Name:	Smith Structural Group, LLP
SE Firm Address:	811 El Capitan Way, Suite 240, San Luis Obispo, CA, 93401
SE Firm Phone #:	805-439-2110

ELIGIBILITY EVALUATION REPORT

School District:	Bakersfield City School District	Original Report Date:	August 15, 2018
School Campus:	Horace Mann Elementary School	Last Revision Date:	
School Address:	2710 Niles Street, Bakersfield, CA 93306		
Building Name/ID:	Multi-purpose & Classrooms		
Project Tracking No.:			Page 19 of 36

C NC U <input type="checkbox"/> NA	<p>AXIAL STRESS CHECK (Steel columns). The axial stress due to gravity loads in steel columns subjected to seismic overturning forces shall be less than $0.10F_y$. Alternatively, the axial stresses due to overturning forces alone, calculated using the Quick Check procedure of Section 3.5.3.6, shall be less than $0.30F_y$.</p> <p><i>(Moment frames not used)</i></p>
C NC U <input type="checkbox"/> NA Critical Item	<p>FLAT SLAB FRAMES. The seismic force-resisting system shall not be a frame consisting of columns and a flat slab/plate without beams.</p> <p><i>(Moment frames not used)</i></p>
C NC U <input type="checkbox"/> NA	<p>PRESTRESSED FRAME ELEMENTS. The seismic force-resisting frames shall not include any prestressed or post-tensioned elements where the average prestress exceeds the lesser of 700 psi or $f' / 6$ at potential hinge locations. The average prestress shall be calculated in accordance with the Quick Check Procedure of Section 3.5.3.8.</p> <p><i>(Moment frames not used)</i></p>
C NC U <input type="checkbox"/> NA Critical Item	<p>CAPTIVE COLUMNS. There shall be no columns at a level with height/depth ratios less than 50% of the nominal height/depth ratio of the typical columns at that level.</p> <p><i>(Moment frames not used)</i></p>
C NC U <input type="checkbox"/> NA	<p>NO SHEAR FAILURES. The shear capacity of frame members in the seismic force-resisting system shall be able to develop the moment capacity at the ends of the members.</p> <p><i>(Moment frames not used)</i></p>
C NC U <input type="checkbox"/> NA	<p>STRONG COLUMN/WEAK BEAM. The sum of the moment capacity of the columns shall be 20% greater than that of the beams at concrete frame joints.</p> <p><i>(Moment frames not used)</i></p>
C NC U <input type="checkbox"/> NA	<p>STRONG COLUMN/WEAK BEAM. The percent of strong column/weak beam joints in each story of each line of steel moment-resisting frames shall be greater than 50%. This check need not apply for 1-story structures.</p> <p><i>(Moment frames not used)</i></p>

SE Firm Name:	Smith Structural Group, LLP
SE Firm Address:	811 El Capitan Way, Suite 240, San Luis Obispo, CA, 93401
SE Firm Phone #:	805-439-2110

PR 08-03
SMP Template
(iss 09-15-11)
(errata 10-11-11)

ELIGIBILITY EVALUATION REPORT

School District:	Bakersfield City School District	Original Report Date:	August 15, 2018
School Campus:	Horace Mann Elementary School	Last Revision Date:	
School Address:	2710 Niles Street, Bakersfield, CA 93306		
Building Name/ID:	Multi-purpose & Classrooms		
Project Tracking No.:			Page 20 of 36

C NC U <input type="checkbox"/> NA	BEAM BARS. At least two longitudinal top and two longitudinal bottom bars shall extend continuously throughout the length of each frame beam. <i>(Moment frames not used)</i>
C NC U <input type="checkbox"/> NA	COLUMN BAR SPLICES. All column bar lap splice lengths shall be greater than $35d_b$, and shall be enclosed by ties spaced at or less than $8d_b$. Alternatively, column bars shall be spliced with mechanical couplers with a capacity of at least 1.25 times the nominal yield strength of the spliced bar. <i>(Moment frames not used)</i>
C NC U <input type="checkbox"/> NA	BEAM BAR SPLICES. The lap splices or mechanical couplers for longitudinal beam reinforcing shall not be located within $l_b/4$ of the joints and shall not be located in the vicinity of potential plastic hinge locations. <i>(Moment frames not used)</i>
C NC U <input type="checkbox"/> NA	COLUMN TIE SPACING. Frame columns shall have ties spaced at or less than $d/4$ throughout their length and at or less than $8d_b$ at all potential plastic hinge locations. <i>(Moment frames not used)</i>
C NC U <input type="checkbox"/> NA	STIRRUP SPACING. All beams shall have stirrups spaced at or less than $d/2$ throughout their length. At potential plastic hinge locations stirrups shall be spaced at or less than the minimum of $8d_b$ or $d/4$. <i>(Moment frames not used)</i>
C NC U <input type="checkbox"/> NA	JOINT REINFORCING. Beam-column joints shall have ties spaced at or less than $8d_b$. <i>(Moment frames not used)</i>
C NC U <input type="checkbox"/> NA	COMPLETE FRAMES. Concrete frames that are not part of the seismic force-resisting system shall form a complete gravity load carrying system. <i>(Moment frames not used)</i>

SE Firm Name:	Smith Structural Group, LLP
SE Firm Address:	811 El Capitan Way, Suite 240, San Luis Obispo, CA, 93401
SE Firm Phone #:	805-439-2110

ELIGIBILITY EVALUATION REPORT

School District:	Bakersfield City School District	Original Report Date:	August 15, 2018
School Campus:	Horace Mann Elementary School	Last Revision Date:	
School Address:	2710 Niles Street, Bakersfield, CA 93306		
Building Name/ID:	Multi-purpose & Classrooms		
Project Tracking No.:			Page 21 of 36

<p>C NC U <input type="checkbox"/> NA</p> <p>Critical Item</p>	<p>DEFLECTION COMPATIBILITY. Elements of concrete frames that are not part of the seismic force-resisting system shall have the shear capacity to develop the flexural strength of the components.</p> <p><i>(Moment frames not used)</i></p>
<p>C NC U <input type="checkbox"/> NA</p> <p>Critical Item</p>	<p>FLAT SLABS. Flat slabs/plates that are not part of the seismic force-resisting system shall have continuous bottom steel through the column joints.</p> <p><i>(Moment frames not used)</i></p>
<p>C NC U <input type="checkbox"/> NA</p> <p>Critical Item</p>	<p>REDUNDANCY (Moment frame). The number of lines of moment frames in each principal direction shall be greater than or equal to 2.</p> <p><i>(Moment frames not used)</i></p>
<p>C NC U <input type="checkbox"/> NA</p>	<p>INTERFERING WALLS. All concrete and masonry infill walls placed in moment frames shall be isolated from structural elements. (This evaluation statement does not apply to seismic force-resisting system type C3A or others where the infill is being evaluated as a shear wall or force-resisting element.)</p> <p><i>(Moment frames not used)</i></p>
<p>C NC U <input type="checkbox"/> NA</p>	<p>PRECAST CONNECTION CHECK. The connections at joints of precast concrete frames shall have the capacity to resist the shear and moment demands calculated using the Quick Procedure of Section 3.5.3.5</p> <p><i>(Moment frames not used)</i></p>
<p>C NC U <input type="checkbox"/> NA</p>	<p>PRECAST FRAMES. For buildings with concrete shear walls, precast concrete frame elements shall not be necessary as primary components for resisting seismic forces.</p> <p><i>(Moment frames not used)</i></p>
<p>C NC U <input type="checkbox"/> NA</p>	<p>PRECAST CONNECTIONS. For buildings with concrete shear walls, the connections between precast frame elements such as chords, ties, and collectors in the seismic force-resisting system shall develop the capacity of the connected members.</p> <p><i>(Moment frames not used)</i></p>

SE Firm Name:	Smith Structural Group, LLP
SE Firm Address:	811 El Capitan Way, Suite 240, San Luis Obispo, CA, 93401
SE Firm Phone #:	805-439-2110

ELIGIBILITY EVALUATION REPORT

School District:	Bakersfield City School District	Original Report Date:	August 15, 2018
School Campus:	Horace Mann Elementary School	Last Revision Date:	
School Address:	2710 Niles Street, Bakersfield, CA 93306		
Building Name/ID:	Multi-purpose & Classrooms		
Project Tracking No.:			Page 22 of 36

C NC U <input type="checkbox"/> NA	<p>DRIFT CHECK: The drift ratio of the steel moment frames, calculated using the Quick Check procedure of Section 3.5.3.1, shall be less than 0.025.</p> <p><i>(Moment frames not used)</i></p>
C NC U <input type="checkbox"/> NA	<p>MOMENT-RESISTING CONNECTIONS: All moment connections shall be able to develop the strength of the adjoining members or panel zones.</p> <p><i>(Moment frames not used)</i></p>
C NC U <input type="checkbox"/> NA	<p>PANEL ZONES: All panel zones shall have the shear capacity to resist the shear demand required to develop 0.8 times the sum of the flexural strengths of the girders framing in at the face of the column.</p> <p><i>(Moment frames not used)</i></p>
C NC U <input type="checkbox"/> NA	<p>COLUM SPLICES: All column splice details located in moment-resisting frames shall include connection of both flanges and the web.</p> <p><i>(Moment frames not used)</i></p>
C NC U <input type="checkbox"/> NA	<p>COMPACT MEMBERS: All frame elements shall meet section requirements set forth by Table I-9-1 of Seismic Provisions for Structural Steel Buildings (AISC, 1997).</p> <p><i>(Moment frames not used)</i></p>
SHEAR WALLS	
C NC U <input type="checkbox"/> NA Critical Item	<p>UNREINFORCED MASONRY BEARING WALLS. The seismic force-resisting system in any direction shall not rely on or consist primarily of unreinforced masonry bearing walls.</p> <p><i>Concrete bearing walls</i></p>
<input checked="" type="checkbox"/> NC U NA Critical Item	<p>SHEAR STRESS CHECK (Shear wall). The shear stress in the concrete shear walls, calculated using the Quick Check procedure of Section 3.5.3.3, shall be less than the greater of 100 psi or $2\sqrt{f_c}$.</p> <p><i>See Appendix A.1 for load take-off and Appendix A.2 for calculations. The concrete passes this shear stress check.</i></p>

SE Firm Name:	Smith Structural Group, LLP
SE Firm Address:	811 El Capitan Way, Suite 240, San Luis Obispo, CA, 93401
SE Firm Phone #:	805-439-2110

ELIGIBILITY EVALUATION REPORT

School District:	Bakersfield City School District	Original Report Date:	August 15, 2018
School Campus:	Horace Mann Elementary School	Last Revision Date:	
School Address:	2710 Niles Street, Bakersfield, CA 93306		
Building Name/ID:	Multi-purpose & Classrooms		
Project Tracking No.:			Page 23 of 36

<input checked="" type="checkbox"/> NC U NA	<p>REINFORCING STEEL. In concrete or precast shear walls, the ratio of reinforcing steel area to gross concrete area shall be not less than 0.0015 in the vertical direction and 0.0025 in the horizontal direction. The spacing of reinforcing steel shall be equal to or less than 18 inches.</p> <p><i>See Sheet 6 of Set 1 for reinforcement size and spacing.</i></p> <p><i>10" wall vert ratio = (0.20*2)/(10"*24")=0.0016 ≥ 0.0015 OK</i> <i>10" wall horiz ratio = (0.20*2)/(10"*16")=0.0025 ≥ 0.0025 OK</i></p> <p><i>8" wall vert ratio = (0.11*2)/(8"*16")=0.0017 ≥ 0.0015 OK</i> <i>8" wall horiz ratio = (0.11*2)/(8"*11")=0.0025 ≥ 0.0025 OK</i></p>
C NC U <input checked="" type="checkbox"/> NA	<p>COUPLING BEAMS. The stirrups in coupling beams over means of egress shall be spaced at or less than d/2 and shall be anchored into the confined core of the beam with hooks of 135° or more.</p> <p><i>One story</i></p>
<input checked="" type="checkbox"/> NC U NA Critical Item	<p>REDUNDANCY (Shear wall). The number of lines of shear walls in each principal direction shall be greater than or equal to 2.</p> <p><i>Shear walls at all exterior walls and some internal walls.</i></p>
C NC U <input checked="" type="checkbox"/> NA	<p>PROPORTIONS. The height-to-thickness ratio of masonry infill walls at each story shall be less than 9. (This evaluation statement applies only to seismic force-resisting system type C3A and others where the infill is being evaluated as a shear wall or force-resisting element.)</p> <p><i>(Masonry infill not used)</i></p>
C NC U <input checked="" type="checkbox"/> NA	<p>SOLID WALLS. The masonry infill walls shall not be of cavity construction. (This evaluation statement applies only to seismic force-resisting system type C3A and others where the infill is being evaluated as a shear wall or force-resisting element.)</p> <p><i>(Masonry infill not used)</i></p>
C NC U <input checked="" type="checkbox"/> NA	<p>INFILL WALLS. The infill walls shall be continuous to the soffits of the frame beams and to the columns to either side. (This evaluation statement applies only to seismic force-resisting system type C3A and others where the infill is being evaluated as a shear wall or force-resisting element.)</p> <p><i>(Masonry infill not used)</i></p>

SE Firm Name:	Smith Structural Group, LLP
SE Firm Address:	811 El Capitan Way, Suite 240, San Luis Obispo, CA, 93401
SE Firm Phone #:	805-439-2110

ELIGIBILITY EVALUATION REPORT

School District:	Bakersfield City School District	Original Report Date:	August 15, 2018
School Campus:	Horace Mann Elementary School	Last Revision Date:	
School Address:	2710 Niles Street, Bakersfield, CA 93306		
Building Name/ID:	Multi-purpose & Classrooms		
Project Tracking No.:			Page 24 of 36

C NC U NA Critical Item	SHEAR STRESS CHECK (Precast concrete shear walls). The shear stress in the precast panels, calculated using the Quick Check procedure of Section 3.5.3.3, shall be less than the greater of 100 psi or $2\sqrt{f'_c}$. <i>(Precast concrete not used)</i>
C NC U NA	WALL OPENINGS. The total width of openings along any perimeter wall line shall constitute less than 75% of the length of any perimeter shear wall, with the wall piers having height-to-width ratios of less than 2 to 1. <i>Opening percentages ok. Max wall pier ratio of 3.6:1 at north wall of multipurpose.</i>
C NC U NA	CORNER OPENINGS. Walls with openings at a building corner larger than the width of a typical panel shall be connected to the remainder of the wall with collector reinforcing.
C NC U NA Critical Item	SHEAR STRESS CHECK (Brick or hollow clay masonry infill). The shear stress in the masonry shear walls, calculated using the Quick Check procedure of Section 3.5.3.3, shall be less than 30 psi for clay units. <i>(Masonry shear walls not used)</i>
C NC U NA Critical Item	SHEAR STRESS CHECK (Concrete block infill and reinforced masonry shear walls). The shear stress in the masonry shear walls, calculated using the Quick Check procedure of Section 3.5.3.3, shall be less than 70 psi for concrete units. <i>(Masonry shear walls not used)</i>
C NC U NA	PROPORTIONS. The height-to-thickness ratio of unreinforced masonry infill shear walls shall be less than the following: Top story of multi-story building: 9, First story of multi-story building: 15, All other conditions: 13 <i>(Masonry shear walls not used)</i>
C NC U NA	REINFORCING STEEL. In reinforced masonry shear walls, the total vertical and horizontal reinforcing steel ratio shall be greater than 0.002 of the wall with the minimum of 0.0007 in either of the two directions; the spacing of reinforcing steel shall be less than 48"; and all vertical bars shall extend to the top of the walls. <i>(Masonry shear walls not used)</i>

SE Firm Name:	Smith Structural Group, LLP
SE Firm Address:	811 El Capitan Way, Suite 240, San Luis Obispo, CA, 93401
SE Firm Phone #:	805-439-2110

ELIGIBILITY EVALUATION REPORT

School District:	Bakersfield City School District	Original Report Date:	August 15, 2018
School Campus:	Horace Mann Elementary School	Last Revision Date:	
School Address:	2710 Niles Street, Bakersfield, CA 93306		
Building Name/ID:	Multi-purpose & Classrooms		
Project Tracking No.:			Page 25 of 36

BRACED FRAMES

C NC U <input type="checkbox"/> NA	REDUNDANCY: The number of lines of braced frames in each principal direction shall be greater than or equal to 2. <i>(Braced frames not used)</i>
C NC U <input type="checkbox"/> NA	AXIAL STRESS CHECK: The axial stress in the diagonals, calculated using the Quick Check Procedure of Section 3.5.3.4, shall be less than $0.50F_y$. <i>(Braced frames not used)</i>
C NC U <input type="checkbox"/> NA	SLENDERNESS OF DIAGONALS: All diagonal elements required to carry compression shall have Kl/r ratios less than 120. <i>(Braced frames not used)</i>
C NC U <input type="checkbox"/> NA	CONNECTION STRENGTH: All the brace connections shall develop the yield capacity of the diagonals. <i>(Braced frames not used)</i>
C NC U <input type="checkbox"/> NA	K-BRACING: The bracing system shall not include K-braced bays. <i>(Braced frames not used)</i>

DIAPHRAGMS

C <input type="checkbox"/> NC U NA	DIAPHRAGM CONTINUITY. The diaphragm shall not be composed of split-level floors and shall not have expansion joints. <i>Split -level first floor in multi-purpose and split-level roof between multipurpose and classrooms. See Section A-A on Sheet 4 of Set 1.</i>
C <input type="checkbox"/> NC U NA	CROSS TIES. There shall be continuous cross ties between diaphragm chords. <i>Continuous cross-ties do not exist where roof rafters are parallel to concrete wall.</i>

SE Firm Name:	Smith Structural Group, LLP
SE Firm Address:	811 El Capitan Way, Suite 240, San Luis Obispo, CA, 93401
SE Firm Phone #:	805-439-2110

ELIGIBILITY EVALUATION REPORT

School District:	Bakersfield City School District	Original Report Date:	August 15, 2018
School Campus:	Horace Mann Elementary School	Last Revision Date:	
School Address:	2710 Niles Street, Bakersfield, CA 93306		
Building Name/ID:	Multi-purpose & Classrooms		
Project Tracking No.:			Page 26 of 36

C NC <input checked="" type="checkbox"/> NA	<p>ROOF CHORD CONTINUITY. All roof chord elements shall be continuous, regardless of changes in roof elevation.</p> <p><i>Unknown, although it is likely that there is reinforcement at both levels of diaphragms</i></p>
C NC U <input checked="" type="checkbox"/> NA Critical Item	<p>OPENINGS AT SHEAR WALLS. Diaphragm openings immediately adjacent to the shear walls shall be less than 25% of the wall length, and diaphragm openings immediately adjacent to exterior masonry shear walls shall not be greater than 8 ft long.</p> <p><i>Skylights are not immediately adjacent to shear walls. See Roof Plan on Sheet 3.</i></p>
C NC U <input checked="" type="checkbox"/> NA	<p>OPENINGS AT BRACED FRAMES. Diaphragm openings immediately adjacent to the braced frames shall extend less than 25% of the frame length.</p> <p><i>(Braced frames not used)</i></p>
<input checked="" type="checkbox"/> NC U NA	<p>OTHER DIAPHRAGMS. The diaphragm shall not consist of a system other than wood, metal deck, concrete or horizontal bracing.</p> <p><i>Diaphragm is typically wood. Concrete roof diaphragm exists over hallway and balcony. See Sections A-A and B-B on Sheet 2 of Set 1.</i></p>
C NC U <input checked="" type="checkbox"/> NA Critical Item	<p>TOPPING SLAB. Precast concrete diaphragm elements shall be interconnected by a continuous reinforced concrete topping slab.</p>
C NC U <input checked="" type="checkbox"/> NA	<p>STRAIGHT SHEATHING. All straight sheathed diaphragms shall have aspect ratios less than 2 to 1 in the direction being considered.</p>
<input checked="" type="checkbox"/> NC U NA	<p>SPANS. All wood diaphragms with spans greater than 24 ft shall consist of wood structural panels or diagonal sheathing.</p> <p><i>1x6 diagonal sheathing used</i></p>
C <input checked="" type="checkbox"/> NC U NA	<p>UNBLOCKED DIAPHRAGMS. All diagonally sheathed or unblocked wood structural panel diaphragms shall have horizontal spans less than 40 ft and shall have aspect ratios less than or equal to 4 to 1.</p> <p><i>Horizontal span over multipurpose is 90'-0" when loaded in the N-S direction, diaphragm is not blocked.</i></p>

SE Firm Name:	Smith Structural Group, LLP
SE Firm Address:	811 El Capitan Way, Suite 240, San Luis Obispo, CA, 93401
SE Firm Phone #:	805-439-2110

PR 08-03
SMP Template
(iss 09-15-11)
(errata 10-11-11)

ELIGIBILITY EVALUATION REPORT

School District:	Bakersfield City School District	Original Report Date:	August 15, 2018
School Campus:	Horace Mann Elementary School	Last Revision Date:	
School Address:	2710 Niles Street, Bakersfield, CA 93306		
Building Name/ID:	Multi-purpose & Classrooms		
Project Tracking No.:			Page 27 of 36

CONNECTIONS

C <input type="checkbox"/> NC <input type="checkbox"/> U <input type="checkbox"/> NA <input type="checkbox"/>	<p>Critical Item</p> <p>WALL ANCHORAGE. Exterior concrete or masonry walls shall be anchored for out-of-plane forces at each diaphragm level with steel anchors, reinforcing dowels, or straps developed into the diaphragm. Connections shall have adequate strength to resist the connection force calculated in the Quick Check procedure of Section 3.5.3.7.</p> <p><i>Out-of-plane ties do not exist.</i></p>
C <input type="checkbox"/> NC <input type="checkbox"/> U <input type="checkbox"/> NA <input type="checkbox"/>	<p>WOOD LEDGERS. The connection between the wall panels and the diaphragm shall not induce cross-grain bending or tension in the wood ledgers.</p> <p><i>Cross-grain bending is not likely for lateral loads applied to the ledgers. However, for gravity loads, ledgers do tend to rotate in cross-grain bending over time when the bolts are centered in the ledger. See details R1-R1, R2-R2, and R3-R3 for examples of bolts centered in ledgers.</i></p>
C <input type="checkbox"/> NC <input type="checkbox"/> U <input type="checkbox"/> NA <input type="checkbox"/>	<p>PRECAST PANEL CONNECTIONS. There shall be at least two anchors from each precast wall panel into the diaphragm elements.</p> <p><i>(Precast concrete not used)</i></p>
<input checked="" type="checkbox"/> <input type="checkbox"/> NC <input type="checkbox"/> U <input type="checkbox"/> NA <input type="checkbox"/>	<p>STIFFNESS OF WALL ANCHORS. Anchors of concrete or masonry walls to wood structural elements shall be installed taut and shall be stiff enough to limit the relative movement between the wall and the diaphragm prior to engagement of the anchors, as needed for reliable bearing.</p> <p><i>Wall anchors for IP loads were cast in place with the concrete walls and as such are most likely to meet this check.</i></p>
C <input type="checkbox"/> NC <input type="checkbox"/> U <input type="checkbox"/> NA <input type="checkbox"/>	<p>GIRDER/COLUMN CONNECTION. There shall be a positive connection utilizing plates, connection hardware, or straps between girders and their supporting columns. (This evaluation statement applies primarily to precast concrete and masonry systems.)</p>
C <input type="checkbox"/> NC <input type="checkbox"/> U <input type="checkbox"/> NA <input type="checkbox"/>	<p>GIRDERS. Girders supported by walls or pilasters shall have at least two additional column ties securing the anchor bolts. (This evaluation statement applies primarily to precast concrete systems.)</p> <p><i>(Precast concrete not used)</i></p>

SE Firm Name:	Smith Structural Group, LLP
SE Firm Address:	811 El Capitan Way, Suite 240, San Luis Obispo, CA, 93401
SE Firm Phone #:	805-439-2110

ELIGIBILITY EVALUATION REPORT

School District:	Bakersfield City School District	Original Report Date:	August 15, 2018
School Campus:	Horace Mann Elementary School	Last Revision Date:	
School Address:	2710 Niles Street, Bakersfield, CA 93306		
Building Name/ID:	Multi-purpose & Classrooms		
Project Tracking No.:			Page 28 of 36

C NC U <input type="checkbox"/> NA	CORBEL BEARING. If precast concrete frame girders bear on column corbels, the length of bearing shall be greater than 3". <i>(Precast concrete not used)</i>
C NC U <input type="checkbox"/> NA	CORBEL CONNECTIONS. Precast concrete frame girders shall not be connected to corbels with welded elements. <i>(Precast concrete not used)</i>
<input checked="" type="checkbox"/> NC U NA	TRANSFER TO SHEAR WALLS. Diaphragms shall be connected for transfer of loads to shear walls. <i>Sheathing nailed to ledger, ledger bolted to wall</i>
C NC U <input type="checkbox"/> NA	TRANSFER TO STEEL FRAMES. Diaphragms shall be connected for transfer of loads to the steel frames.
C NC U <input type="checkbox"/> NA	TOPPING SLAB TO WALLS OR FRAMES. Reinforced concrete topping slabs that interconnect the precast concrete diaphragm elements shall be doweled for transfer of forces into shear wall or frame elements.
C NC U <input type="checkbox"/> NA	CONCRETE COLUMNS. All concrete columns shall be doweled into the foundation. <i>(Concrete columns not used)</i>
<input checked="" type="checkbox"/> NC U NA	FOUNDATION DOWELS. Wall reinforcement shall be doweled into the foundation. <i>See Sheet 1 of Set 1 for several wall dowel details.</i>
C NC U <input type="checkbox"/> NA	PRECAST WALL PANELS. Precast wall panels shall be connected to the foundation. <i>(Precast panels not used)</i>
C NC U <input type="checkbox"/> NA	UPLIFT AT PILE CAPS. Pile caps shall have top reinforcement and piles shall be anchored to the pile caps. <i>(Piles not used)</i>

SE Firm Name:	Smith Structural Group, LLP
SE Firm Address:	811 El Capitan Way, Suite 240, San Luis Obispo, CA, 93401
SE Firm Phone #:	805-439-2110

ELIGIBILITY EVALUATION REPORT

School District:	Bakersfield City School District	Original Report Date:	August 15, 2018
School Campus:	Horace Mann Elementary School	Last Revision Date:	
School Address:	2710 Niles Street, Bakersfield, CA 93306		
Building Name/ID:	Multi-purpose & Classrooms		
Project Tracking No.:			Page 29 of 36

C NC U <input checked="" type="checkbox"/> NA	<p>STEEL COLUMNS: The columns in lateral-force-resisting frames shall be anchored to the building foundation.</p> <p><i>(Steel frames not used)</i></p>
C NC U <input checked="" type="checkbox"/> NA	<p>WALL PANELS: Metal, fiberglass or cementitious wall panels shall be positively attached to the foundation.</p> <p><i>(Cladding panels not used)</i></p>
C NC U <input checked="" type="checkbox"/> NA	<p>ROOF PANELS: Metal, plastic, or cementitious roof panels shall be positively attached to the roof framing to resist seismic forces.</p> <p><i>(Cladding panels not used)</i></p>
C NC U <input checked="" type="checkbox"/> NA	<p>WALL PANELS: Metal, fiberglass or cementitious wall panels shall be positively attached to the framing to resist seismic forces.</p> <p><i>(Cladding panels not used) Note that the brick veneer is anchored per details on Sheet 4 of Set 1.</i></p>
FOUNDATION	
C NC U <input checked="" type="checkbox"/> NA	<p>POLE FOUNDATIONS. Pole foundations shall have a minimum embedment depth of 4 ft.</p> <p><i>Foundations are conventional concrete continuous and pad footings as well as shallow piers.</i></p>
C <input checked="" type="checkbox"/> NC U NA	<p>TIES BETWEEN FOUNDATION ELEMENTS. The foundation shall have ties adequate to resist seismic forces where footings, piles, and piers are not restrained by beams, slabs, or soils in Site Class A, B, or C.</p> <p><i>Interior footings are not tied. See Sheet 1 of Set 1.</i></p>

GEOLOGIC SITE HAZARDS

SE Firm Name:	Smith Structural Group, LLP
SE Firm Address:	811 El Capitan Way, Suite 240, San Luis Obispo, CA, 93401
SE Firm Phone #:	805-439-2110

PR 08-03
SMP Template
(iss 09-15-11)
(errata 10-11-11)

ELIGIBILITY EVALUATION REPORT

School District:	Bakersfield City School District	Original Report Date:	August 15, 2018
School Campus:	Horace Mann Elementary School	Last Revision Date:	
School Address:	2710 Niles Street, Bakersfield, CA 93306		
Building Name/ID:	Multi-purpose & Classrooms		
Project Tracking No.:			Page 30 of 36

C NC <input checked="" type="checkbox"/> NA Critical Item	LIQUEFACTION: Liquefaction-susceptible, saturated, loose granular soils that could jeopardize the building's seismic performance shall not exist in the foundation soils at depths within 50 feet.
C NC U <input checked="" type="checkbox"/> NA Critical Item	SLOPE FAILURE: The building site shall be sufficiently remote from potential earthquake-induced slope failures or rockfalls to be unaffected by such failures or shall be capable of accommodating any predicted movements without failure.
C NC <input checked="" type="checkbox"/> NA Critical Item	SURFACE FAULT RUPTURE: Surface fault rupture and surface displacement at the building site is not anticipated.

SE Firm Name:	Smith Structural Group, LLP
SE Firm Address:	811 El Capitan Way, Suite 240, San Luis Obispo, CA, 93401
SE Firm Phone #:	805-439-2110

PR 08-03
SMP Template
(iss 09-15-11)
(errata 10-11-11)

ELIGIBILITY EVALUATION REPORT

School District:	Bakersfield City School District	Original Report Date:	August 15, 2018
School Campus:	Horace Mann Elementary School	Last Revision Date:	
School Address:	2710 Niles Street, Bakersfield, CA 93306		
Building Name/ID:	Multi-purpose & Classrooms		
Project Tracking No.:			Page 31 of 36

Appendices

A.1 Structural calculations

UNIT WEIGHT

MULTI-PURPOSE + CLASSROOMS		UNIT WEIGHT BREAKDOWN
<u>ROOF</u>		
ROOFING		3.0 PSF
1x6 SHTG		2.25 PSF
2x16 ROOF JOISTS @24" O.C		2.5 PSF
STEEL BEAMS		2.0 PSF
INSULATION		1.0 PSF
T-BAR CEILING (MASTER)		10.0 PSF
ACOUSTIC TILES		1.0 PSF
MEP		0.5 PSF
		<hr/>
		22.5 PSF
<u>WALLS</u>		
10" CONC =	$150 \text{ PCF} (10" / 12) =$	125 PSF
5" BRICK VENEER =		50 PSF

SE Firm Name:	Smith Structural Group, LLP
SE Firm Address:	811 El Capitan Way, Suite 240, San Luis Obispo, CA, 93401
SE Firm Phone #:	805-439-2110

ELIGIBILITY EVALUATION REPORT

School District:	Bakersfield City School District	Original Report Date:	August 15, 2018
School Campus:	Horace Mann Elementary School	Last Revision Date:	
School Address:	2710 Niles Street, Bakersfield, CA 93306		
Building Name/ID:	Multi-purpose & Classrooms		
Project Tracking No.:			Page 32 of 36


ATC HAZARDS RESPONSE SPERCTRUM INFORMATION

ATC Hazards by Location


Search Information

Address: 2710 Niles St, Bakersfield, CA 93306, USA
Coordinates: 35.37690810000001, -118.9574422
Timestamp: 2018-07-16T17:06:25.321Z
Hazard Type: Seismic
Reference Document: ASCE7-05
Risk Category: III
Site Class: D
Report Title: Horace Mann Elementary School


Map Results

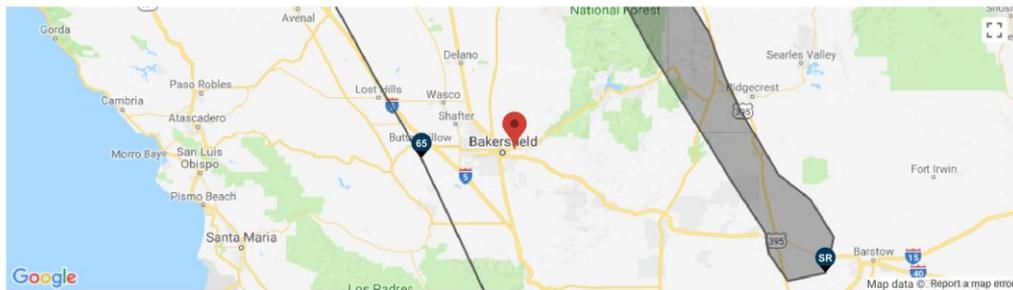

MCER Horizontal Response Spectrum

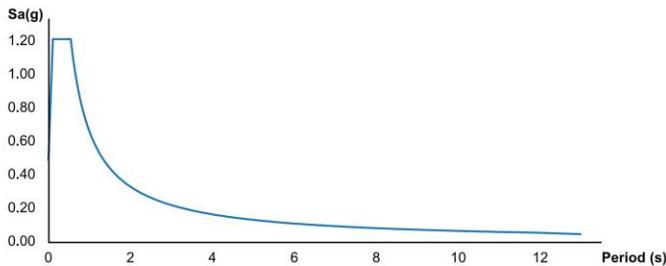

Design Horizontal Response Spectrum

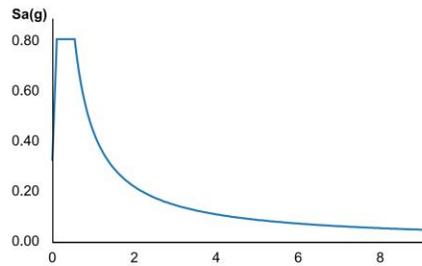

Text Results

Basic Parameters

Name	Value	Description
S_S	1.18	MCE _R ground motion (period=0.2s)
S_1	0.419	MCE _R ground motion (period=1.0s)
S_{MS}	1.213	Site-modified spectral acceleration value
S_{M1}	0.662	Site-modified spectral acceleration value
S_{DS}	0.809	Numeric seismic design value at 0.2s SA
S_{D1}	0.441	Numeric seismic design value at 1.0s SA

SE Firm Name:	Smith Structural Group, LLP
SE Firm Address:	811 El Capitan Way, Suite 240, San Luis Obispo, CA, 93401
SE Firm Phone #:	805-439-2110

ELIGIBILITY EVALUATION REPORT

School District:	Bakersfield City School District	Original Report Date:	August 15, 2018
School Campus:	Horace Mann Elementary School	Last Revision Date:	
School Address:	2710 Niles Street, Bakersfield, CA 93306		
Building Name/ID:	Multi-purpose & Classrooms		
Project Tracking No.:			

ATC HAZARDS RESPONSE SPECTRUM INFORMATION (continued)

SDC	D	Seismic design category
F _a	1.028	Site amplification factor at 0.2s
F _v	1.581	Site amplification factor at 1.0s
T _L	12	Long-period transition period (s)

SE Firm Name:	Smith Structural Group, LLP
SE Firm Address:	811 El Capitan Way, Suite 240, San Luis Obispo, CA, 93401
SE Firm Phone #:	805-439-2110

ELIGIBILITY EVALUATION REPORT

School District:	Bakersfield City School District	Original Report Date:	August 15, 2018
School Campus:	Horace Mann Elementary School	Last Revision Date:	
School Address:	2710 Niles Street, Bakersfield, CA 93306		
Building Name/ID:	Multi-purpose & Classrooms		
Project Tracking No.:			Page 34 of 36

BASE SHEAR/PSEUDO-LATERAL FORCE

<u>PSEUDO LATERAL FORCE</u>	
$V = C S_a W$	ASCE 31, EQN. 3-1
$S_a = \frac{S_{D1}}{T}$, BUT $\leq S_{D5}$	EQN. 3-4
$= 2.25$	$S_{D5} = 0.809g$
$\therefore S_a = S_{D5} = 0.809g$	$S_{D1} = 0.441g$
	$T = C_t h_n^B$ EQN. 3-8
	$C_t = 0.020$
	$h_n = 2' (AVG.)$ } SEC 3.5.2.4
	$B = 0.75$ }
	$T = 0.196s$
$C = 1.0$ & TABLE 3-4	
$W =$ EFFECTIVE SEISMIC WEIGHT	
$W_{ROOF} = 8,200 ft^2 (22.5 PSF) = 184.5K$	
$W_{WALLS (N/S)} = 8' (125 PSF + 50 PSF) \times 286'$	
$+ 5' (125 PSF + 50 PSF) (0.7) \times 286'$	$= 575.6K$
$GLAZING = 5' (15 PSF) (0.3) \times 286'$	$= 6.5K$
$W_{WALLS (E)} = 6' (125 PSF + 50 PSF) \times 83'$	
$+ 5' (125 PSF + 50 PSF) (0.5) \times 83'$	$= 124K$
$W_{WALLS (W)} = 15' (125 PSF + 50 PSF) (0.7) \times 42'$	
$+ 10' (125 PSF + 50 PSF) \times 41'$	$= 149K$
$GLAZING = 5' (15 PSF) (0.5) \times 83' + 15' (15 PSF) (0.3) \times 42'$	$= 3.3K$

SE Firm Name:	Smith Structural Group, LLP
SE Firm Address:	811 El Capitan Way, Suite 240, San Luis Obispo, CA, 93401
SE Firm Phone #:	805-439-2110

ELIGIBILITY EVALUATION REPORT

School District:	Bakersfield City School District	Original Report Date:	August 15, 2018
School Campus:	Horace Mann Elementary School		
School Address:	2710 Niles Street, Bakersfield, CA 93306	Last Revision Date:	
Building Name/ID:	Multi-purpose & Classrooms		
Project Tracking No.:		Page 35 of 36	

BASE SHEAR/PSEUDO-LATERAL FORCE (continued)

$$\begin{array}{l}
 W_{TOTAL} = 1043K \\
 V = 1.0(0.809)(1043K) \longrightarrow \underline{V = 844K}
 \end{array}$$

SE Firm Name:	Smith Structural Group, LLP
SE Firm Address:	811 El Capitan Way, Suite 240, San Luis Obispo, CA, 93401
SE Firm Phone #:	805-439-2110

ELIGIBILITY EVALUATION REPORT

School District:	Bakersfield City School District	Original Report Date:	August 15, 2018
School Campus:	Horace Mann Elementary School	Last Revision Date:	
School Address:	2710 Niles Street, Bakersfield, CA 93306		
Building Name/ID:	Multi-purpose & Classrooms		
Project Tracking No.:			Page 36 of 36

A.2 Evaluation statement notes

SHEAR STRESS (Concrete)

STRESS IN SHEARWALLS

$$V_j^{AVG} = \frac{1}{m} \left(\frac{V_j}{A_w} \right) \quad \text{§ EQN 3-12} \quad V_j = V = 844K$$

A_w OF WALLS IN EACH DIRECTION

SOUTH WALLS: $10'' \times (143' - 8(4')) = 13,320 \text{ in}^2$ 77.6% SOLID

NORTH WALLS: $10'' \times (143' - 14(4')) = 10,440 \text{ in}^2$ 60.8% SOLID

EAST WALLS: $10'' \times (10' + 12' + 10') = 3,840 \text{ in}^2$ 88.6% SOLID

WEST WALLS: $10'' \times (83' - 22') = 7,320 \text{ in}^2$ 73.5% SOLID

$$V_j @ \text{ EAST WALLS} = \frac{844K}{2} = 422K \quad m=4.0, \text{ CONC. } \left\{ \begin{array}{l} \text{§ TBL.} \\ \text{3-7} \end{array} \right.$$

$$V_{AVG.} = \frac{1}{4.0} \left(\frac{422K}{3,840 \text{ in}^2} \right) = \underline{\underline{0.028 \text{ psi} \quad (28 \text{ psi})}}$$

100psi OR $2\sqrt{f'_c}$ MAX SHEAR STRESS ALLOWED

$$2\sqrt{2,000 \text{ psi}} = 89 \text{ psi} \sim \text{ALLOWED}$$

FACTOR FROM DSA $\rightarrow \frac{28 \text{ psi}}{1.33} = 21 \text{ psi}$ IS APPLIED

$\therefore 21 \text{ psi} < 89 \text{ psi}$, O.K.

A.3 Photographs and details (not used)

SE Firm Name:	Smith Structural Group, LLP
SE Firm Address:	811 El Capitan Way, Suite 240, San Luis Obispo, CA, 93401
SE Firm Phone #:	805-439-2110