ALARY SYSTEM REPLACEMENT O a lifornia

REPLACEMENT OF EXISTING CAMPUS FIRE ALARM SYSTEM GENERALLY THE SCOPE OF WORK INCLUDES, BUT IS NOT LIMITED TO SUCH ITEMS AS, FIRE ALARM MASTER PANEL, DEVICES AND BRANCH CIRCUITING. SITE ANALYSIS

MASHINGTON JUNIOR HIGH SCHOOL

LEGAL DESCRIPTION

Bakersfield, California 93305

(EXISTING SCHOOL SITE)

1101 Noble Avenue

1998 CALIFORNIA BUILDING CODE (CBC), PART 2, TITLE 24 C.C.R. (1997 UNIFORM BUILDING CODE VOLUMES 1-3 AND 1998 CALIFORNIA AMENDMENTS)

998 CALIFORNIA MECHANICAL CODE (CMC), PART 4, TITLE 24 C.C.R. (1997 UNIFORM MECHANICAL CODE AND 1998 CALIFORNIA AMENDMENTS)

98 CALIFORNIA PLUMBING CODE (CPC), PART 5, TITLE 24 C.C.R. 997 UNIFORM PLUMBING CODE AND 1998 CALIFORNIA AMENDMENTS)

APPLICABLE CODES AND

MT. VERNON AVE.

(A) IT IS THE MITHER OF THESE PLANE AND SECRETARIANG TO CORRECT LIMITATION OF THE MITHER OF THE MITHER OF THE MITHER OF THE MITHER AND LEAST RECORDED TO PROVIDE COPYRITE AND CERTAINES STRIPES. CONTRIGORD SHALL MITERALS AND LEAST RECORDED TO PROVIDE COPYRITE AND CERTAINES STRIPES. CONTRIGORD SHALL MITERAL CONTRIGORD SHA

ELECTRICAL KEYNOTE: DENOTES KEYNOTE # OF NOTES ON SAME SHEET.

CONDUIT IN ATTICAMAL: DENOTES PANEL A, CKT. #3, -3/4°C, MINIMAN, U.O.N.

CONDUIT IN ATTICAMAL: DENOTES 1/2°C - 2 #12 AWG CU THAN + 1 #12 CU GND

CONDUIT RUN: DENOTES 1/2°C - 3 #12 AWG CU THAN + 1 #12 CU GND

CONDUIT RUN: DENOTES 3/4°C - 4 #12 AWG CU THAN + 1 #12 CU GND

CONDUIT RUN: DENOTES 3/4°C - 5 #12 AWG CU THAN + 1 #12 CU GND

CONDUIT RUN: DENOTES 3/4°C - 5 #12 AWG CU THAN + 1 #12 CU GND

CONDUIT RUN: DENOTES 1°C - 6 #12 AWG CU THAN + 1 #12 CU GND

CONDUIT RUN: DENOTES 1°C - 6 #12 AWG CU THAN + 1 #12 CU GND

CONDUIT RUN: DENOTES 1°C - 6 #12 AWG CU THAN + 1 #12 CU GND

LUNDERGROUND SYSTEMS PULL BOX PER PLANS.

BATTERY OPERATED EMERGENCY LIGHTING FIXTURE

MALL MOUNTED LIGHTING FIXTURE

CEILING MOUNTED LIGHTING FIXTURE

CEILING MOUNTED LIGHTING FIXTURE

CEILING MOUNTED LIGHTING FIXTURE WITH EMERGENCY BATTERY PACK PER PLANS

CEILING MOUNTED LIGHTING FIXTURE WITH EMERGENCY BATTERY PACK PER PLANS

CEILING MOUNTED LIGHTING FIXTURE

DUPLEX RECEPTACLE IN WALL @ +18", U.O.N.

DUPLEX GROUND FAULT INTERRUPTING RECEPTACLE IN WALL @ +18", U.O.N.

DUPLEX ISOLATED GROUND RECEPTACLE IN WALL @ +18", U.O.N.

QUADRUPLEX RECEPTACLE IN WALL @ +18", U.O.N.

JUNCTION BOX WITH FLEXIBLE CONDUIT CONNECTION TO EQUIPMENT PUSIBLE DISCONNECT SWITCH

HUSIBLE DISCONNECT SWITCH WITH INTEGRAL MAGNETIC STARTER

STUB ONE I 1/4"C., ONE I"C., AND TWO 3/4"C. INTO ACCESSIBLE ATTIC SPACE ABOVE NEAREST T-BAR CEILING U.O.N.. REQUIREMENT APPLIES TO EACH POWER AND LIGHTING PANEL INDICATED FLUSH MOUNTED ON POWER PLAN.

RUN I''C. CONCEALED IN WALL TO ACCESSIBLE ATTIC SPACE T-BAR CEILING, U.O.N.

FIRE ALARY INSTALLATION SEQUENCING AND SCHEDULING

(A) MAINTAIN EXISTING FIRE ALARM EQUIPMENT FULLY OPERATIONAL UNTIL NEW FIRE ALARM EQUIPMENT HAS BEEN TESTED AND ACCEPTED.

(B) AS THE NEW FIRE ALARM EQUIPMENT IS INSTALLED, LABEL IT "NOT IN SERVICE" UNTIL SUCH TIME AS IT IS ACCEPTED.

(C) REMOVE LABELS FROM THE NEW FIRE ALARM EQUIPMENT WHEN IT IS PUT INTO SERVICE AND LABEL EXISTING FIRE ALARM EQUIPMENT AS "NOT IN SERVICE" UNTIL IT IS PUT INTO SERVICE AND LABEL EXISTING FIRE ALARM EQUIPMENT AS "NOT IN SERVICE" UNTIL IT IS REMOVED.

(E) PACKAGE OPERATIONAL FIRE ALARM AND DETECTION EQUIPMENT THAT HAS BEEN REMOVED AND DELIVER TO OWNER FOR DISPOSITION.

(F) REMOVE HROM THE SITE AND LEGALLY DISPOSE OF EXISTING MATERIAL NOT DESIGNATED FOR OTHER DISPOSITION.

X:/JOBS/02/2002-2X/2002-2I/2002-2I-E.3.DWG MVW

CRITICAL RADIANT FLUX OF FLOOR COVERING SYSTEMS

NFPA 13

1996 EDITION

199 EDITION

10 TITLE 19, C.C.R., PUBLIC SAFETY; STATE FIRE MARSHAL REGULATI


18 CALIFORNIA REFERENCED STANDARDS, PART 12, 11TLE 24 C.R.R.


FIRE ALARM SYSTEM REPLACEMENT

BAKERSFIELD CITY SCHOOL DISTRICT

WASHINGTON JUNIOR HIGH SCHOOL

Bakersfield, California

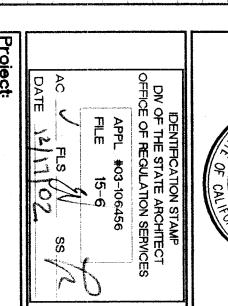



ELECTRICAL SYMBOL SCHEDULE
DIMENSIONS INDICATED ARE MEASURED TO CENTERLINE OF ENCLOSURE, UNLINOTE: SOME SYMBOLS SHOWN MAY NOT APPLY TO THIS F
DENOTES LICHTING FIXTURE CIRCUIT, FIXTURE TYPE AND FIXTURE M



