PRIME CONSULTANT

COPYRIGHT:

CONSULTANT

**AGENCY INFORMATION:** 

IBI Group is forbidden.

NO. DATE APPRD.

ARCHITECTURE PLANNING

4119 Broad Street, Suite 210 San Luis Obispo, CA 93401

805.546.0433 fax: 805.546.0504

San Luis Obispo

**REVISIONS** 

AGENCY TRACKING NO. 63321-273


**IDENTIFICATION STAMP** 


DIV. OF THE STATE ARCHITECT OFFICE OF REGULATION SERVICES

ACTION FLS FELSS CL

FILE NO. 15-6



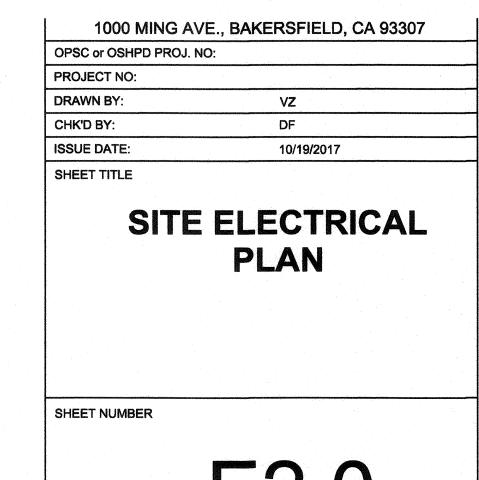

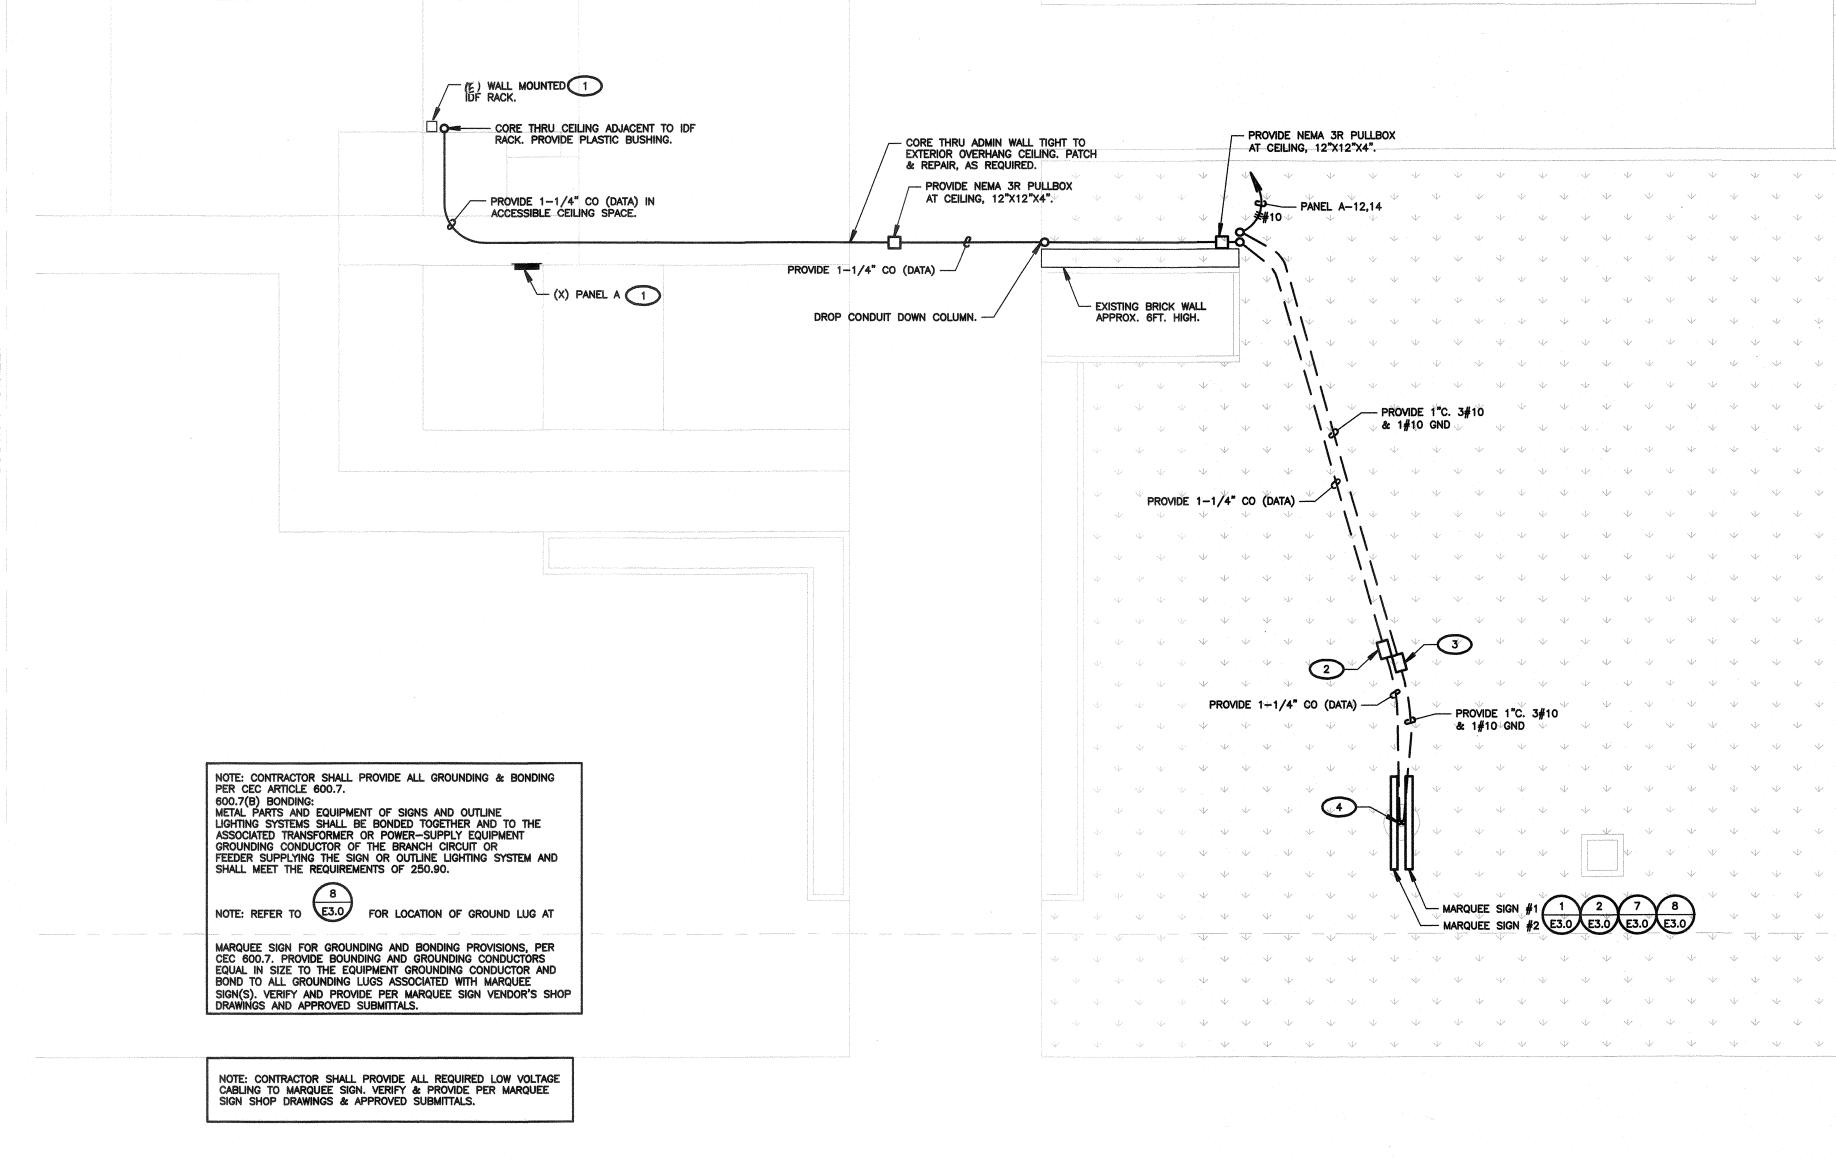

SHEET NOTES

SITE ELECTRICAL PLAN

SCALE: 1"=60'-0"

CONTRACTOR SHALL CALL UNDERGROUND SERVICE ALERT AT 811
TO LOCATE UNDERGROUND UTILITIES AT LEAST 2 WORKING DAYS
PRIOR TO DIGGING. CONTRACTOR SHALL FIELD VERIFY LOCATION
AND DEPTH OF EXISTING IMPROVEMENTS PRIOR TO START OF

MING AVENUE

VERIFY LOCATION OF ALL BUILDINGS AND APPENDITURES ON ARCHITECTURAL AND CIVIL PLANS.

FIELD VERIFY LOCATION ON ALL UNDERGROUND UTILITIES PRIOR TO TRENCHING. SCHEDULE AND COORDINATE ALL SITE WORK WITH OWNER PRIOR TO ANY TRENCHING.

4. CONTRACTOR SHALL VERIFY LOCATION & REQUIREMENTS OF ALL DEVICES/EQUIPMENT REQUIRING ELECTRICAL CONNECTION PRIOR TO BID PROPOSAL, ROUGH-IN, AND FINISH.

5. CONTRACTOR SHALL, IN ROUTING ALL CIRCUITS, INCREASE CONDUCTOR & CONDUIT SIZE TO ALLOW FOR VOLTAGE DROP SHOULD THE CONTRACTOR EXCEED ROUTING INDICATED ON DRAWINGS. ENGINEER OF RECORD MUST BE NOTIFIED PRIOR TO ANY DEVIATIONS FROM APPROVED PLAN CHECK (PERMIT SET)

6. ALL 90 DEGREE CONDUIT BENDS AND RISERS SHALL BE PVC COATED RIGID STEEL.

CONTRACTOR SHALL COORDINATE AND PROVIDE ALL SITE ELECTRICAL SERVICE REQUIREMENTS WITH SERVING UTILITY.

8. ALL SERVICE ENTRANCE EQUIPMENT SHOP DRAWINGS SHALL BE SUBMITTED TO THE LOCAL UTILITY COMPANY FOR APPROVAL, WITH WRITTEN APPROVAL RECEIVED PRIOR TO SUBMISSION TO ELECTRICAL ENGINEER FOR APPROVAL.

9. VERIFY LOCATION OF ALL EQUIPMENT ON ARCHITECTURAL AND CIVIL PLANS.

10. MINIMUM CONDUIT BURIAL DEPTH IS 24", 36" MINIMUM BELOW STREETS AND PARKING LOTS. FOR 0-600 VOLT SYSTEMS.

11. PROVIDE CODE SIZED EQUIPMENT GROUNDING CONDUCTORS IN

ALL OCCUPIED CONDUITS.

12. 1" CONDUIT MINIMUM UNDERGROUND. 13. COORDINATE WORK WITH OTHER TRADES. OBTAIN ALL DRAWINGS THAT WILL REQUIRE COORDINATION AND PROVIDE ALL ELECTRICAL CONNECTIONS, DEVICES, AND WIRING REQUIRED. WHETHER SHOWN ON THE ELECTRICAL DRAWINGS OR NOT.

14. CONTRACTOR SHALL FURNISH AND INSTALL PULL BOXES AS REQUIRED TO INSTALL CONDUCTORS PER CONDUCTOR MANUFACTURERS RECOMMENDATIONS, PER THE NATIONAL ELECTRICAL CODE, AND PER LOCAL AUTHORITIES HAVING JURISDICTION.

15. FIELD CONDITIONS GOVERN DEMOLITION AND NEW CONSTRUCTION. CONTRACTOR SHALL VERIFY ACTUAL CONDITIONS PRIOR TO START OF WORK. THE ARCHITECT/ENGINEER SHALL BE NOTIFIED OF POSSIBLE FIELD PROBLEMS PRIOR TO DEMOLITION. CONTRACTOR SHALL NOTIFY DISTRICT REPRESENTATIVE OF WORK BEING PERFORMED. COORDINATE WITH DISTRICT REPRESENTATIVE.

16. ALL EMPTY CONDUITS SHALL BE PROVIDED WITH DIMENSIONED NYLON PULL STRING.

17. CONTRACTOR SHALL FIELD VERIFY LOCATION OF ALL UNDERGROUND UTILITIES PRIOR TO ANY EXCAVATION OR TRENCHING. CONTRACTOR SHALL PROTECT ALL EXISTING/REMAINING UTILITIES IN PLACE. CONTRACTOR, AT HIS SOLE EXPENSE, SHALL REPAIR ANY UTILITY SYSTEMS DAMAGED DURING CONSTRUCTION. KEY NOTES

(NOTE: THESE NOTES MAY NOT APPEAR ON ALL SHEETS) APPROXIMATE LOCATION. CONTRACTOR SHALL FIELD VERIFY EXACT LOCATION.

PROVIDE COMMUNICATIONS PULLBOX.
PROVIDE 11"X17" TRAFFIC RATED PULLBOX WITH STEEL CHECKER PLATE COVER ENGRAVED WITH "COMMUNICATIONS". #B1017BOX WITH #B1017-51JH COVER, BY CHRISTY CONCRETE.

PROVIDE POWER PULLBOX. PROVIDE
11"X17" TRAFFIC RATED PULLBOX WITH
STEEL CHECKER PLATE COVER ENGRAVED
WITH "ELECTRIC". #B1017BOX WITH #B1017-51JH COVER. BY CHRISTY CONCRETE.

COMMUNICATIONS CABLES SHALL BE PROVIDED IN SEPARATE RACEWAY WITHIN METAL POLE. PROVIDE 1-1/4" LIQUID TITE FLEXIBLE NONMETALLIC CONDUIT FOR COMMUNICATIONS CABLES. VERIFY & PROVIDE PER MARQUEE SIGN VENDOR'S SHOP DRAWINGS & APPROVED SUBMITTALS. MARQUEE SIGN ELECTRICAL PLAN

Know what's below.

Call before you dig.