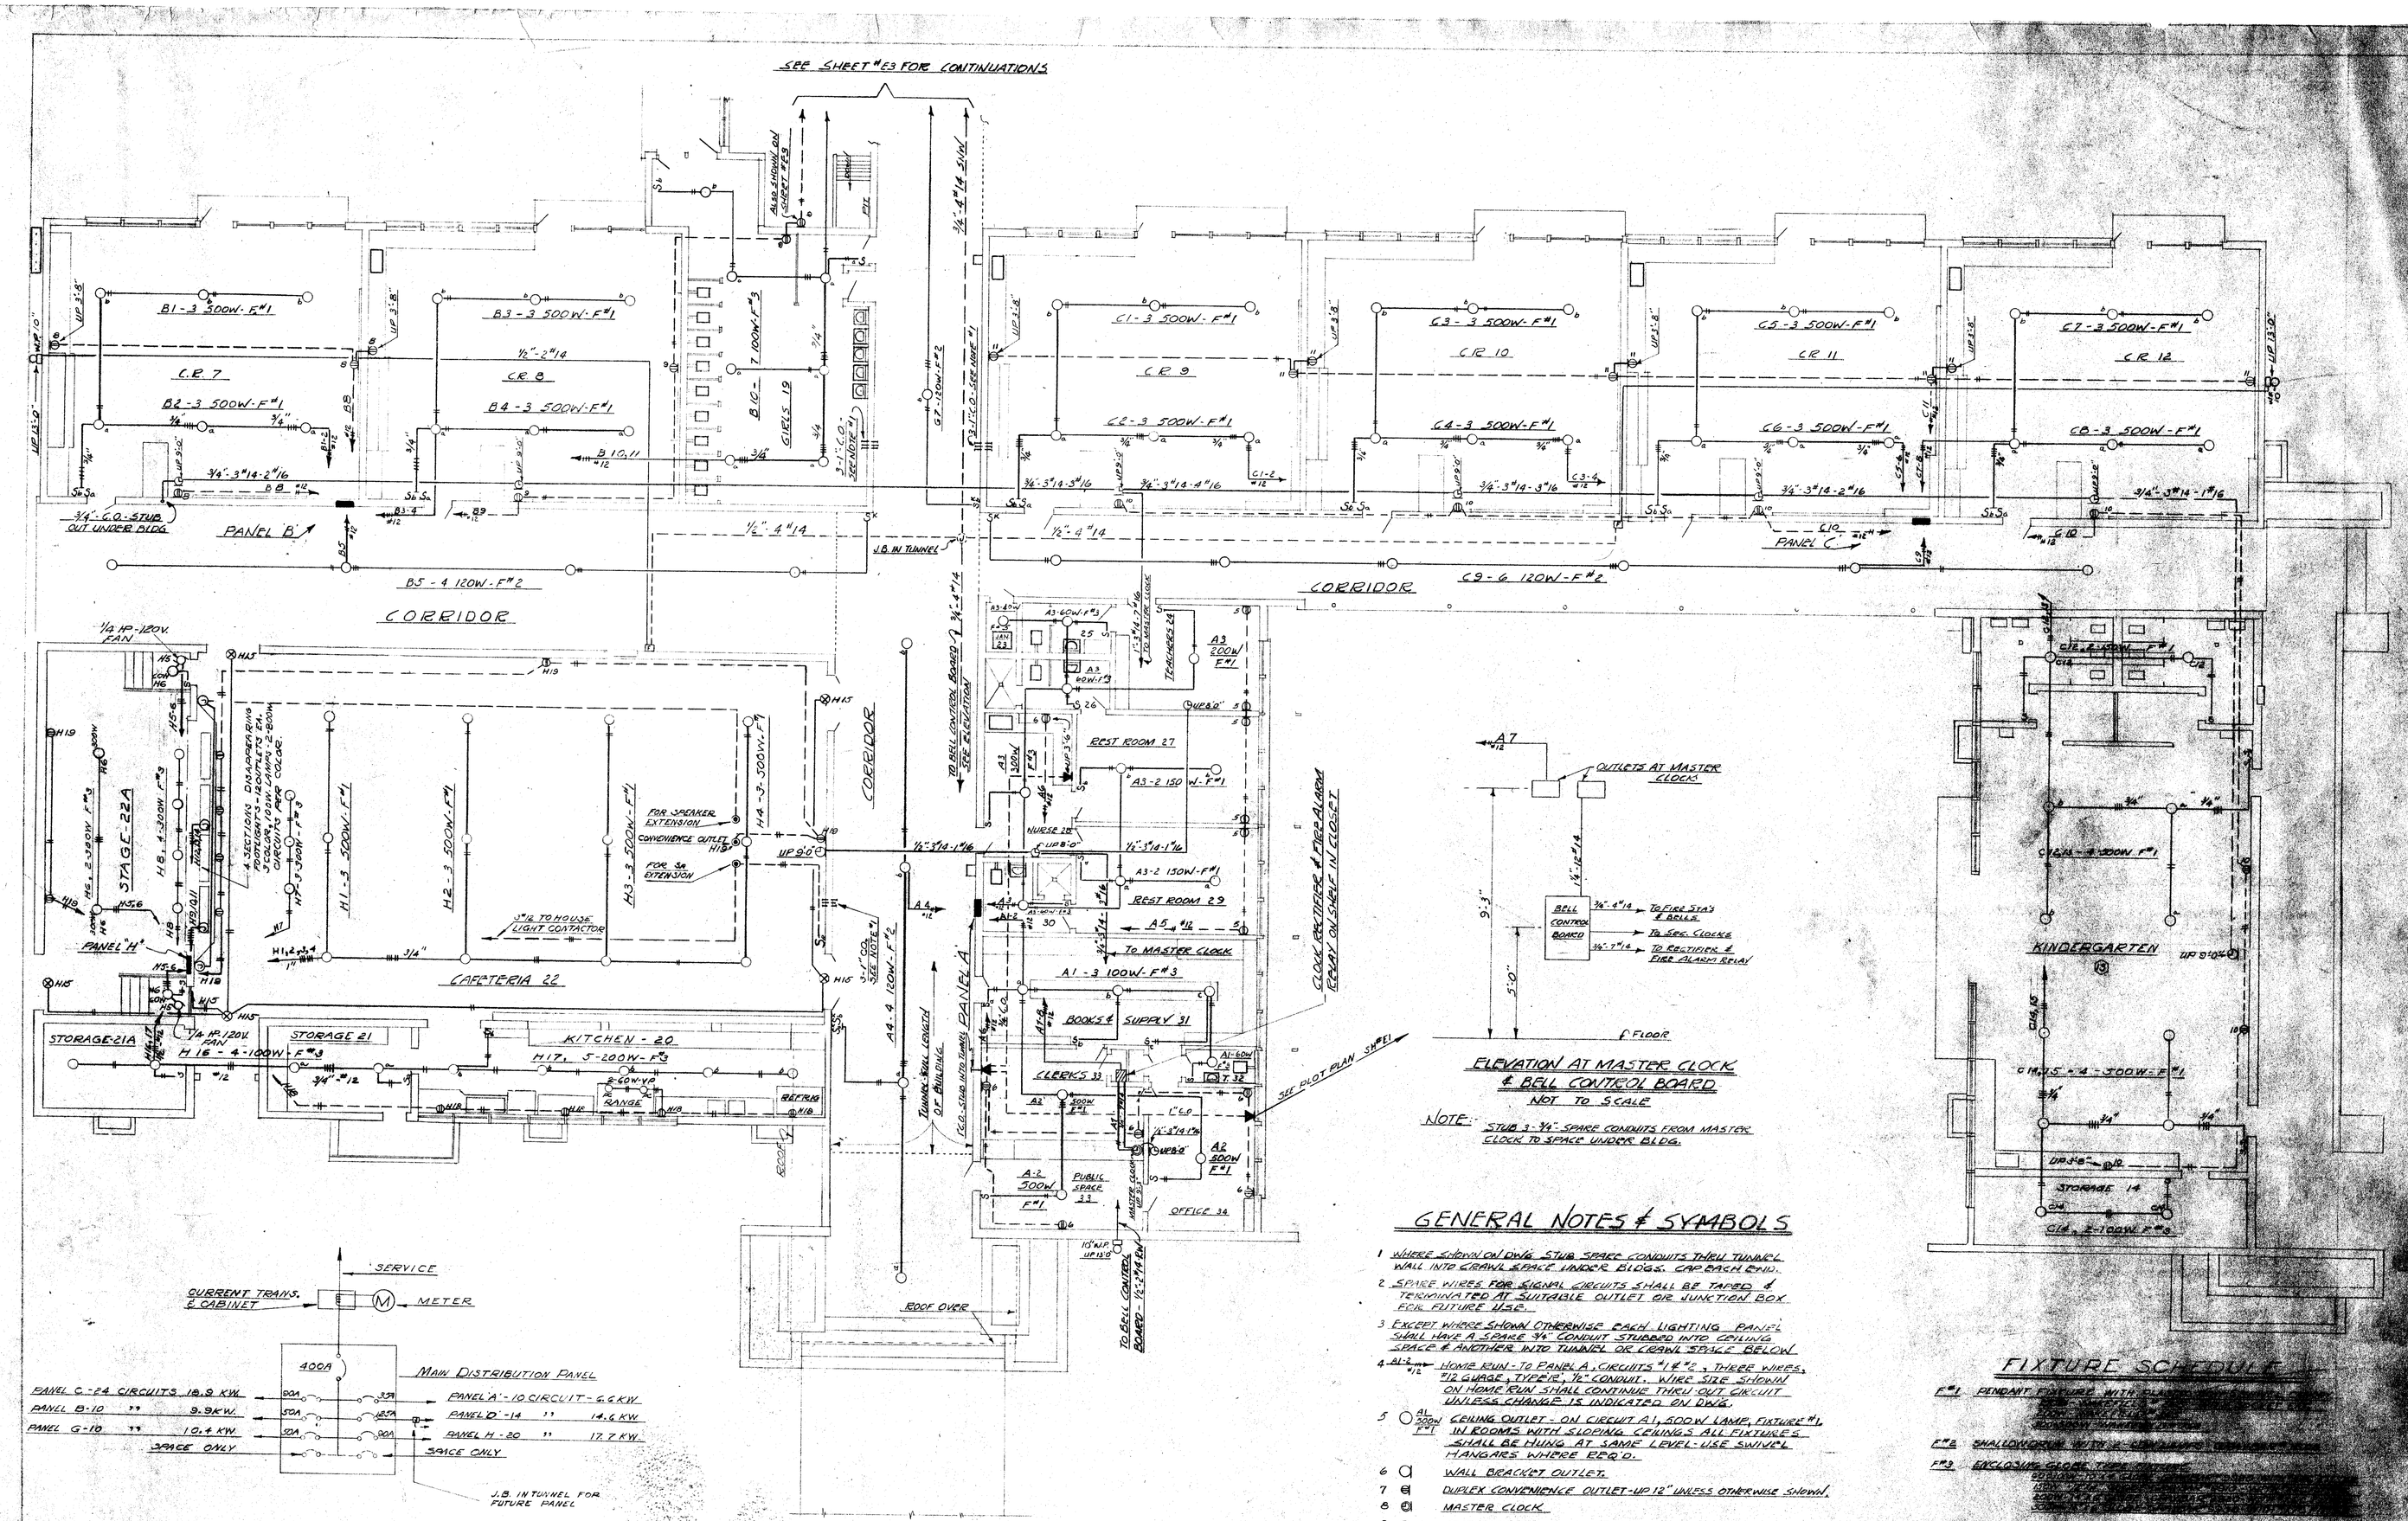

FEEDER DIAGRAM

MAIN DISTRIBUTION PANEL:- SURFACE MOUNTING CABINET, 125/250V.-1Ø-3 WIRE-SN MAINS & BRANCHES, ALL BREAKERS TYPE "AB"-250V.

LIGHTING PANELS "K", B, C, D, G & H" - FLUSH MOUNTING CABINETS, 13A-125V-1 POLE-SN BRANCH CIRCUITS, LUGS ONLY IN MAINS.

CIRCUITS "H1, 2, 3" ON PANEL H, SHALL BE ON A SEPARATE BUS WITH REMOTE CONTROL FROM A 100 AMP. 2 POLE LATCH-TYPE CONTACTOR, SQUARE-D CO. TYPE 8702 E, CLASS 8702B.

GENERAL NOTES & SYMBOLS

1. WHERE SHOWN ON DWG. STUB SPARE CONDUITS THRU TUNNEL WALL INTO CRAWL SPACE UNDER BLDGS. CAP BACK END.
2. SPARE WIRES FOR SIGNAL CIRCUITS SHALL BE TAPED & TERMINATED AT SUITABLE OUTLET OR JUNCTION BOX FOR FUTURE USE.
3. EXCEPT WHERE SHOWN OTHERWISE EACH LIGHTING PANEL SHALL HAVE A SPARE 3/4" CONDUIT STUBBED INTO CEILING SPACE & ANOTHER INTO TUNNEL OR CRAWL SPACE BELOW.
4. A1-2 #12 — HOME RUN - TO PANEL A, CIRCUITS #1 & #2, THREE WIRES, #12 GAUGE, TYPE R, 3/4" CONDUIT. WIRE SIZE SHOWN ON HOME RUN SHALL CONTINUE THRU OUT CIRCUIT UNLESS CHANGE IS INDICATED ON DWG.
5. A1 500W F#1 — CEILING OUTLET - ON CIRCUIT A1, 500 W. LAMP, FIXTURE #1, IN ROOMS WITH SLOPING CEILINGS ALL FIXTURES SHALL BE HUNG AT SAME LEVEL - USE SWIVEL HANGARS WHERE REQ'D.
6. WALL BRACKET OUTLET.
7. DUPLEX CONVENIENCE OUTLET - UP 12" UNLESS OTHERWISE SHOWN.
8. MASTER CLOCK
9. SECONDARY CLOCK - WITH BUZZER IN CASE
10. SIGNAL GONG - WEATHER PROOF
11. FIRE ALARM STATION
12. S_K — WALL SWITCH - SUPERSCRIPT K INDICATES KEY TYPE, SUPERSCRIPT 3 INDICATES 3 WAY SWITCH, NO SUPER SCRIPT INDICATES PLAIN SWITCH, SUBSCRIPT LETTER INDICATES RATHER'S SWITCHED.
13. 3/4" — CONDUIT IN CEILING OR WALL - CROSS LINES INDICATE NUMBER OF WIRES - ALL CONDUIT 1/2" UNLESS SHOWN OTHERWISE
14. CONDUIT UNDER FLOOR OR UNDER GROUND
15. TELEPHONE OUTLET - PULL WIRES SHALL BE INSTALLED IN TELEPHONE CONDUITS FOR TELEPHONE CO. USE.
16. S_R — REMOTE CONTROL TUMBLER SWITCH
17. EXIT LIGHT OUTLET - FLUSH TYPE
18. FLOOR OUTLET AS NOTED
19. DISAPPEARING FOOTLIGHTS - KLIEGL TYPE #872.

FIXTURE SCHEDULE

F#1 PENDANT FIXTURE WITH [redacted]

F#2 SHALLOW CEIL[redacted]

F#3 ENCLOSURE GLOBE TYPE [redacted]

F#4 VAPOR TIGHT [redacted]

F#5 PORCELAIN [redacted]

A296

APPROVED: 10-26-45
Harry W. Bolin

APPROVED: _____ 1945.
BOARD OF EDUCATION
PRESIDENT.
SECRETARY.

HILBURG, BYLER & HENGSTLER
MECHANICAL & ELECTRICAL ENGINEERS
129 WEST 2nd ST. LOS ANGELES, CALIF.

ELECTRICAL
FRANKLIN SCHOOL
TENTATIVE ADDITIONAL SCHOOL
FOR
BAKERSFIELD CITY SCHOOL DIST.
BAKERSFIELD, CALIFORNIA